

NOTES:

1. CABLE GROUNDING AND GROUND CLEARANCE TO MEET NATIONAL ELECTRIC SAFETY CODE REQUIREMENTS
2. MINIMUM SPACING BETWEEN COMMUNICATION ATTACHMENT POINTS AT POLE MAY HAVE TO BE INCREASED TO MEET SPAN SEPARATION CODE REQUIREMENTS PER NATIONAL ELECTRIC SAFETY CODE
3. LOWEST COMMUNICATION CABLE SHALL MEET MINIMUM SAG RELATED CLEARANCE OVER LAND OR WATER SURFACES PER NATIONAL ELECTRIC SAFETY CODE


	ORIGINAL	REVISION	REVISION	REVISION
DRWN BY	S.L.T., SR.	R.J.D.	D.J.C.	D.J.C.
CHKD	C.J.F.	K.N.D.	D.J.C.	D.J.C.
APPD	C.J.F.	J.K.L.	J.K.L.	
DATE	4/22/93	5/23/05	9/7/06	7/27/18
CADD DRAWING - DO NOT MODIFY MANUALLY				

POLE ATTACHMENT CLEARANCES

**CLECO POWER, LLC**

PINEVILLE, LOUISIANA

EXHIBIT 1
SCALE: NTS
SH. ___ OF ___ SHEETS

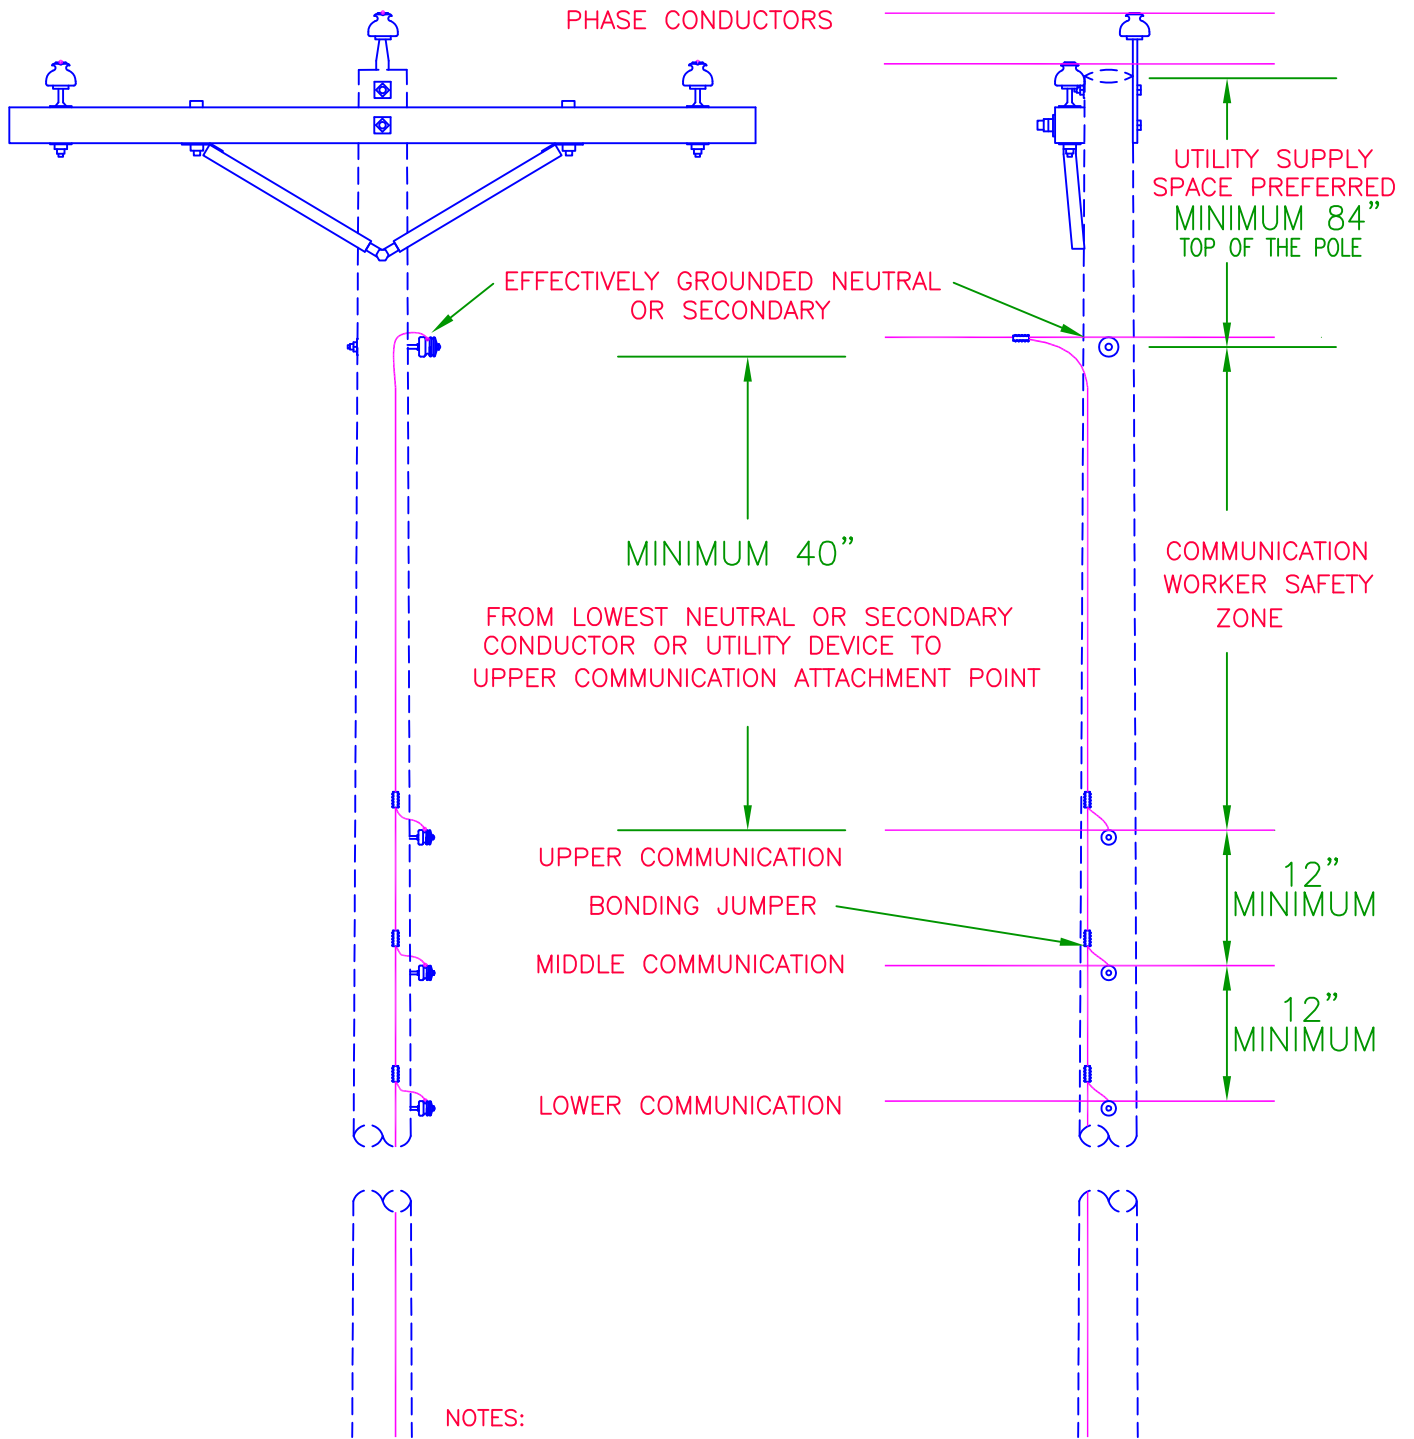

NOTES:

1. CABLE GROUNDING AND GROUND CLEARANCE TO MEET NATIONAL ELECTRIC SAFETY CODE REQUIREMENTS
2. MINIMUM SPACING BETWEEN COMMUNICATION ATTACHMENT POINTS AT POLE MAY HAVE TO BE INCREASED TO MEET SPAN SEPARATION REQUIREMENTS PER NATIONAL ELECTRIC SAFETY CODE
3. LOWEST COMMUNICATION CABLE SHALL MEET MINIMUM SAG RELATED CLEARANCE OVER LAND OR WATER SURFACES PER NATIONAL ELECTRIC SAFETY CODE


	ORIGINAL	REVISION	REVISION	REVISION
DRWN BY	S.L.T., SR.	R.J.D.	D.J.C.	D.J.C.
CHKD	C.J.F.	K.N.D.	D.J.C.	D.J.C.
APPD	C.J.F.	J.K.L.	J.K.L.	D.J.C.
APPD				
DATE	4/22/93	5/23/05	9/7/06	7/27/18
CADD DRAWING - DO NOT MODIFY MANUALLY				

POLE ATTACHMENT CLEARANCES

**CLECO POWER, LLC**

PINEVILLE, LOUISIANA

EXHIBIT 2
SCALE: 3/8"=1'
SH. ___ OF ___ SHEETS

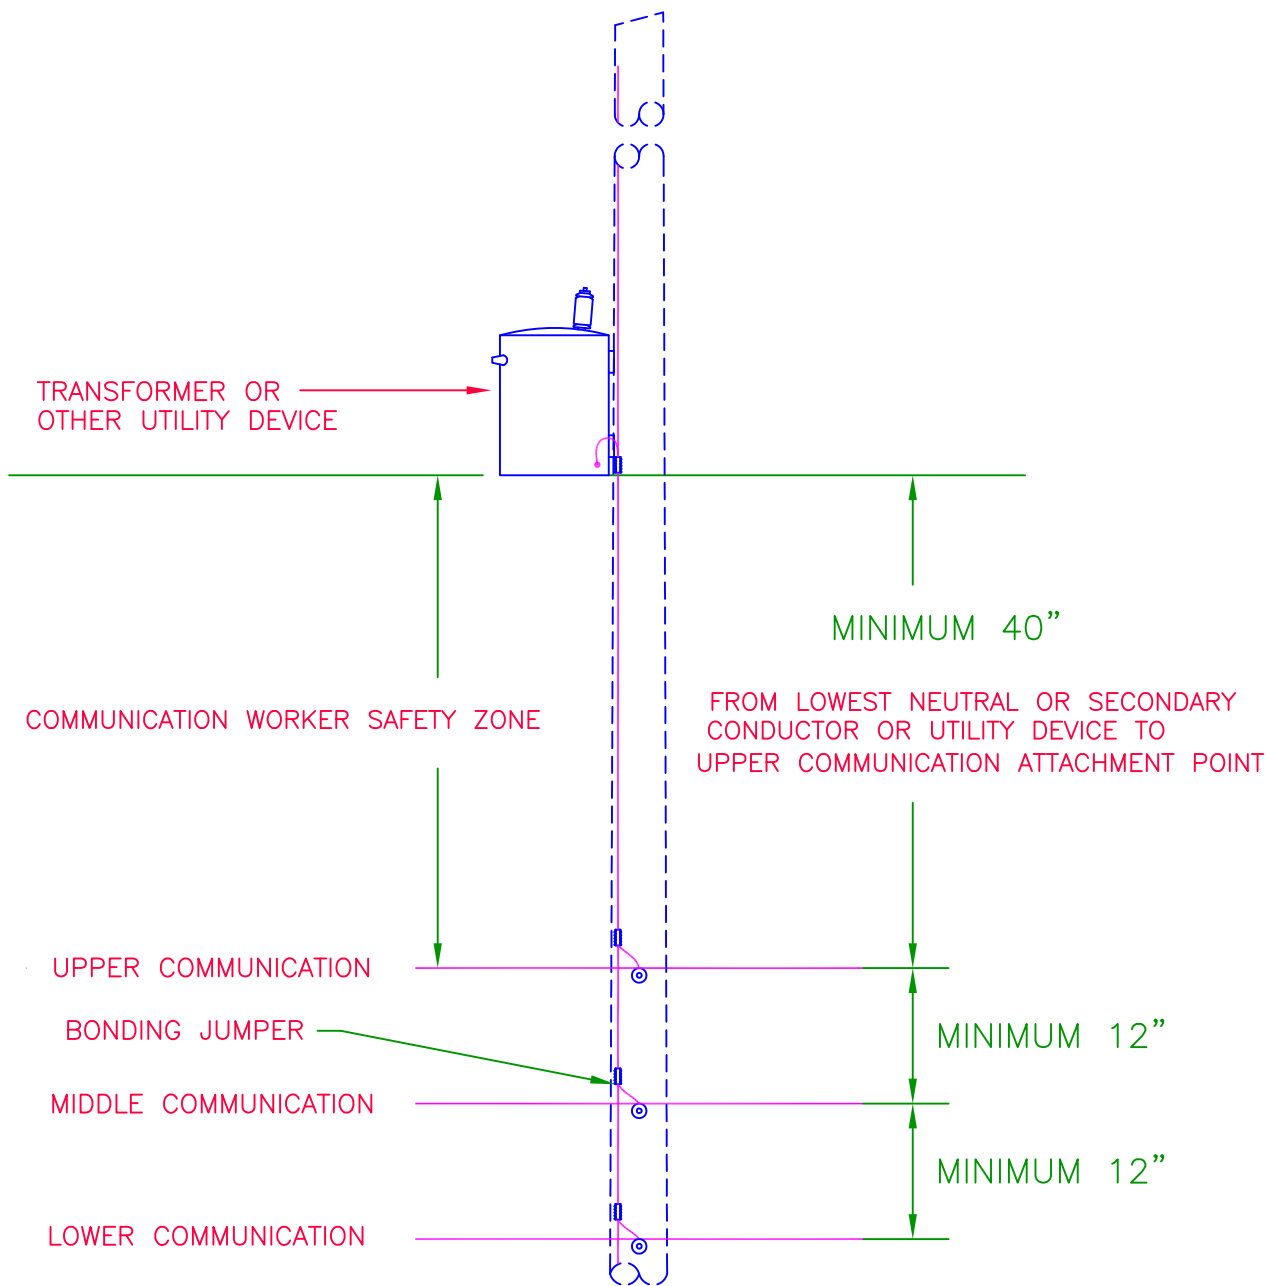

NOTES:

1. CABLE GROUNDING AND GROUND CLEARANCE TO MEET NATIONAL ELECTRIC SAFETY CODE REQUIREMENTS
2. MINIMUM SPACING BETWEEN COMMUNICATION ATTACHMENT POINTS AT POLE MAY HAVE TO BE INCREASED TO MEET SPAN SEPARATION REQUIREMENTS PER NATIONAL ELECTRIC SAFETY CODE
3. LOWEST COMMUNICATION CABLE SHALL MEET MINIMUM SAG RELATED CLEARANCE OVER LAND OR WATER SURFACES PER NATIONAL ELECTRIC SAFETY CODE


	ORIGINAL	REVISION	REVISION	REVISION
DRWN BY	S.L.T., SR.	R.J.D.	D.J.C.	D.J.C.
CHKD	C.J.F.	K.N.D.	D.J.C.	D.J.C.
APPD	C.J.F.	J.K.L.	J.K.L.	D.J.C.
APPD				
DATE	4/22/93	5/23/05	9/7/06	7/27/18
CADD DRAWING - DO NOT MODIFY MANUALLY				

POLE ATTACHMENT CLEARANCES

**CLECO POWER, LLC**

PINEVILLE, LOUISIANA

EXHIBIT 3
SCALE: NTS
SH. ___ OF ___ SHEETS

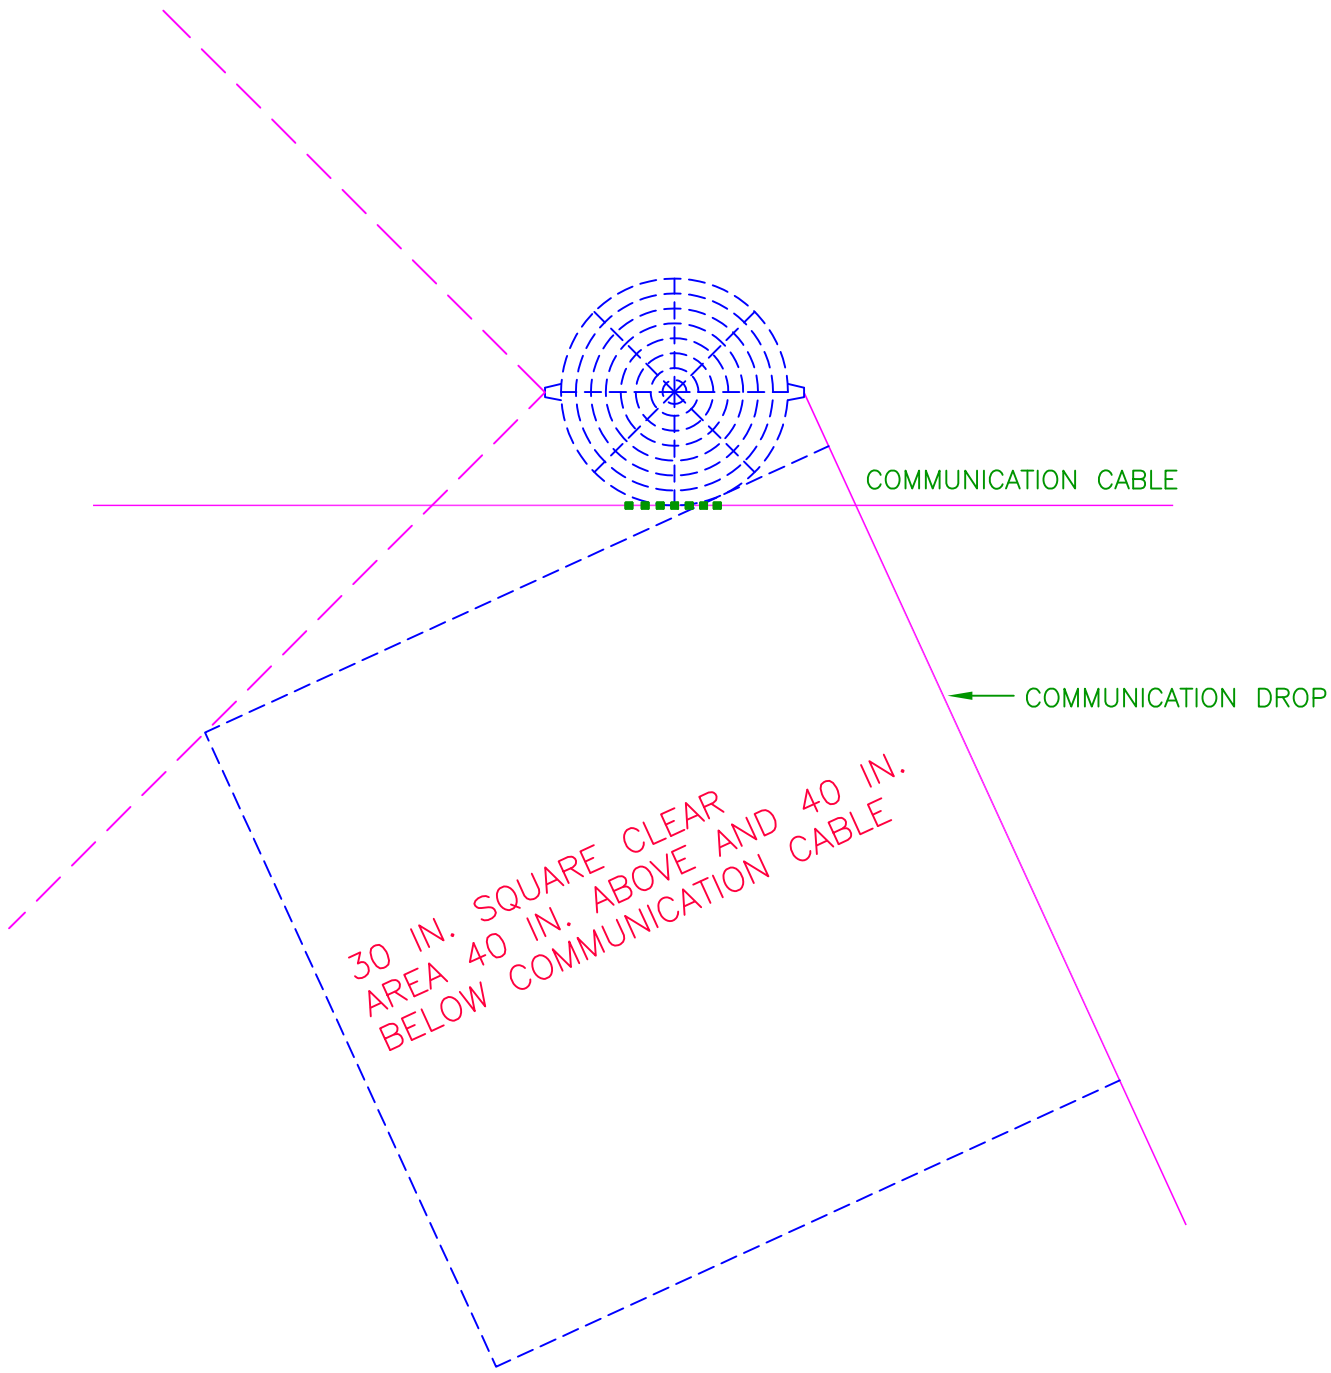


NOTE: CABLE GROUND CLEARANCE TO MEET NATIONAL ELECTRIC SAFETY CODE REQUIREMENTS.

	ORIGINAL	REVISION	REVISION	REVISION
DRWN BY	S.L.T., SR.	R.J.D.	D.J.C.	D.J.C.
CHKD	C.J.F.	K.N.D.	D.J.C.	D.J.C.
APPD	C.J.F.	J.K.L.	J.K.L.	
APPD				
DATE	4/22/93	5/23/05	9/7/06	7/27/18
CADD DRAWING - DO NOT MODIFY MANUALLY				

COMMUNICATIONS ATTACHMENT  
CLEARANCES

**CLECO POWER, LLC**  
PINEVILLE, LOUISIANA

EXHIBIT 4
SCALE: NTS
SH. ___ OF ___ SHEETS

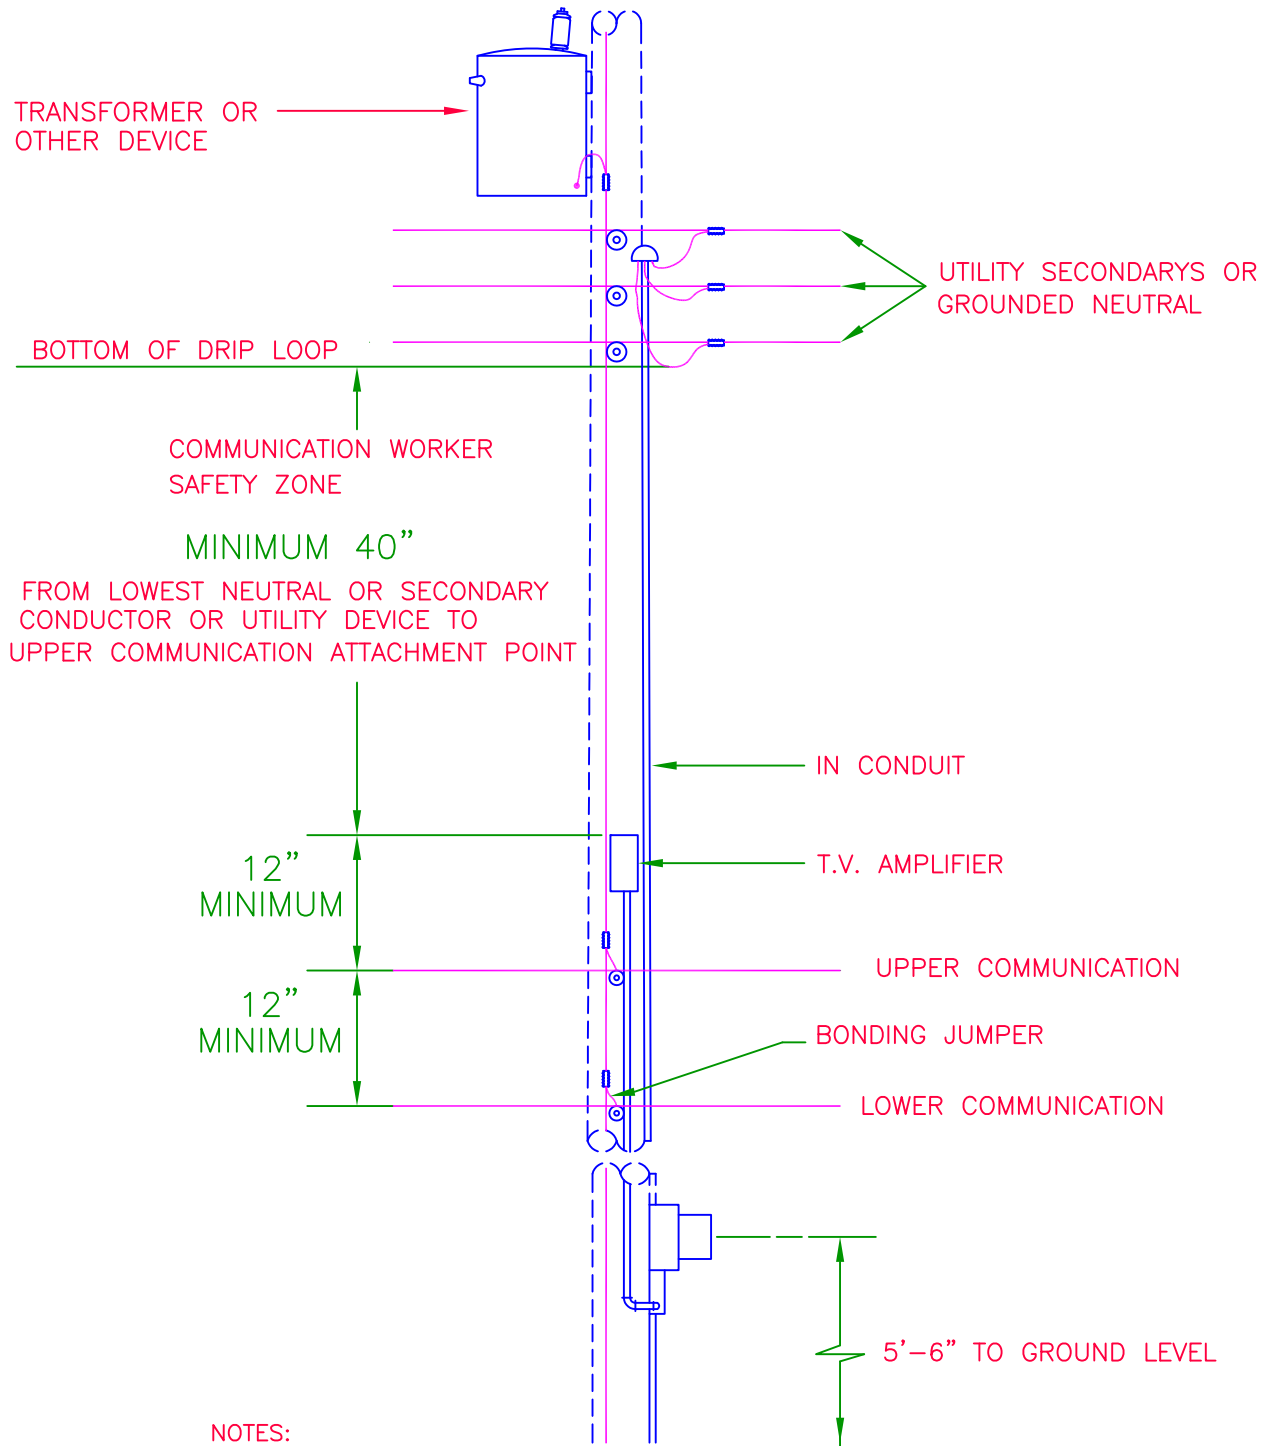

NOTES:

1. CABLE GROUNDING AND GROUND CLEARANCE TO MEET NATIONAL ELECTRIC SAFETY CODE REQUIREMENTS
2. MINIMUM SPACING BETWEEN COMMUNICATION ATTACHMENT POINTS AT POLE MAY HAVE TO BE INCREASED TO MEET SPAN SEPARATION REQUIREMENTS PER NATIONAL ELECTRIC SAFETY CODE
3. LOWEST COMMUNICATION CABLE SHALL MEET MINIMUM SAG RELATED CLEARANCE OVER LAND OR WATER SURFACES PER NATIONAL ELECTRIC SAFETY CODE


	ORIGINAL	REVISION	REVISION	REVISION
DRWN BY	S.L.T., SR.	R.J.D.	D.J.C.	D.J.C.
CHKD	C.J.F.	K.N.D.	D.J.C.	D.J.C.
APPD	C.J.F.	J.K.L.	J.K.L.	D.J.C.
APPD				
DATE	4/22/93	5/23/05	9/7/06	7/27/18
CADD DRAWING - DO NOT MODIFY MANUALLY				

POLE ATTACHMENT CLEARANCES

**CLECO POWER, LLC**

PINEVILLE, LOUISIANA


EXHIBIT 5
SCALE: NTS
SH. ___ OF ___ SHEETS

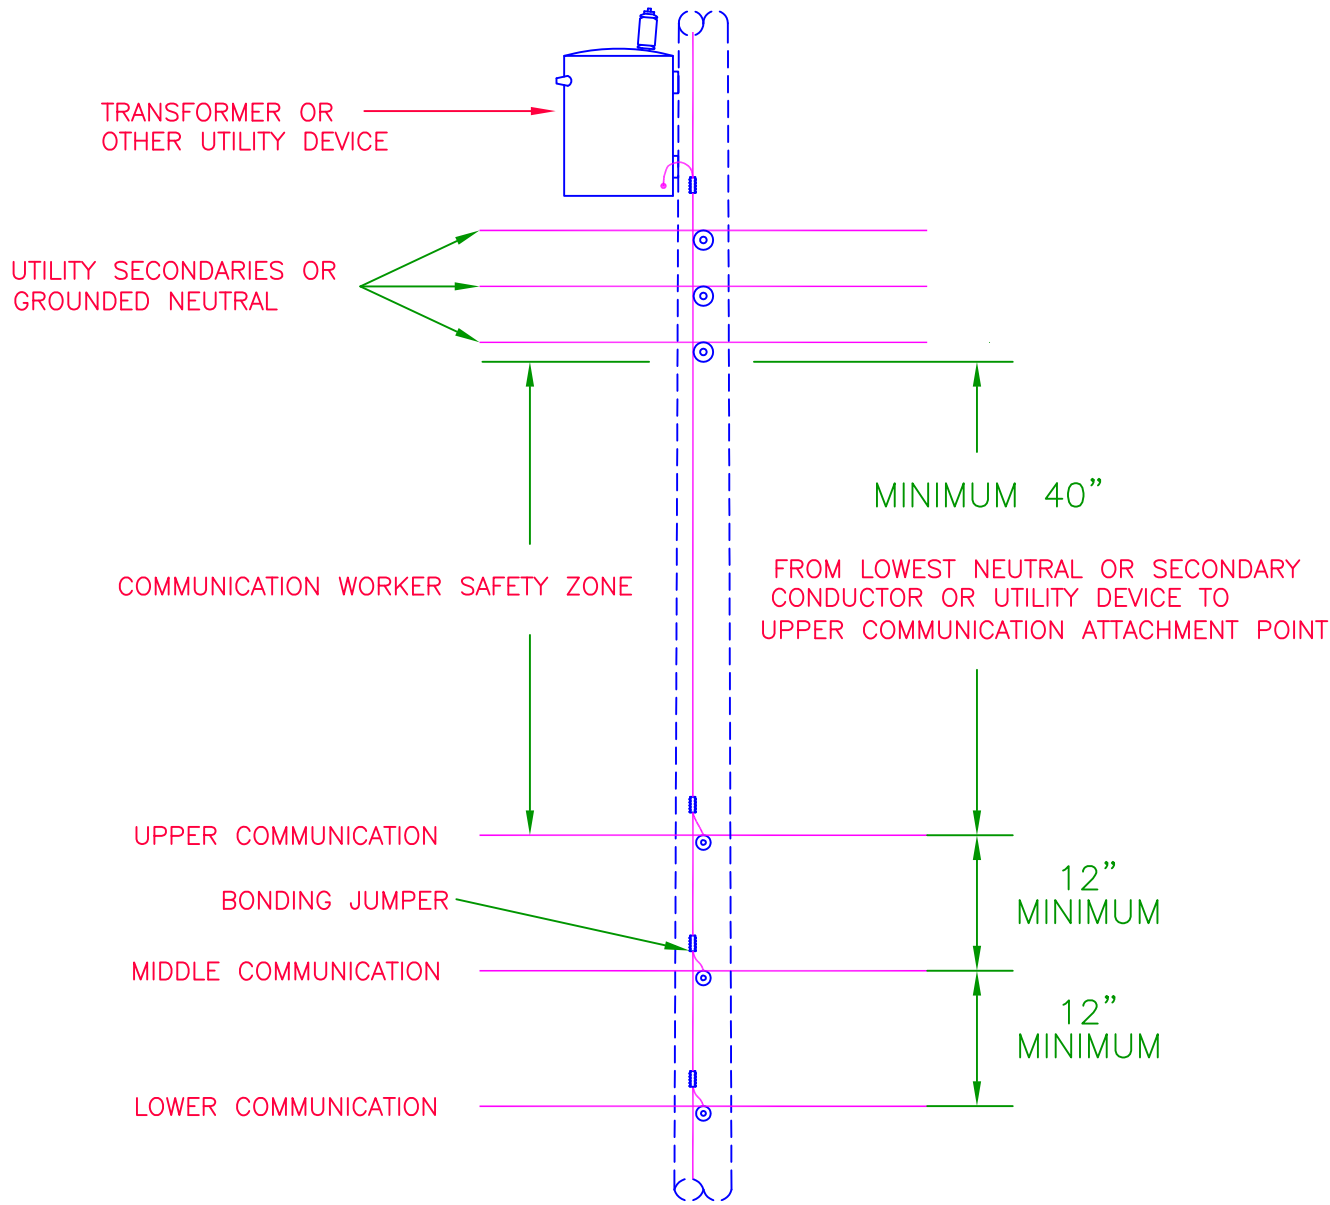

NOTES:

1. CABLE GROUNDING AND GROUND CLEARANCE TO MEET NATIONAL ELECTRIC SAFETY CODE REQUIREMENTS
2. MINIMUM SPACING BETWEEN COMMUNICATION ATTACHMENT POINTS AT POLE MAY HAVE TO BE INCREASED TO MEET SPAN SEPARATION REQUIREMENTS PER NATIONAL ELECTRIC SAFETY CODE
3. LOWEST COMMUNICATION CABLE SHALL MEET MINIMUM SAG RELATED CLEARANCE OVER LAND OR WATER SURFACES PER NATIONAL ELECTRIC SAFETY CODE


	ORIGINAL	REVISION	REVISION	REVISION	<b>POLE ATTACHMENT CLEARANCES</b>  <b>CLECO POWER, LLC</b> PINEVILLE, LOUISIANA	EXHIBIT 6
DRWN BY	S.L.T., SR.	R.J.D.	D.J.C.	D.J.C.		SCALE: NTS
CHKD	C.J.F.	K.N.D.	D.J.C.	D.J.C.		SH. ___ OF
APPD	C.J.F.	J.K.L.	J.K.L.			___ SHEETS
DATE	4/22/93	5/23/05	9/7/06	7/27/18		
CADD DRAWING - DO NOT MODIFY MANUALLY						

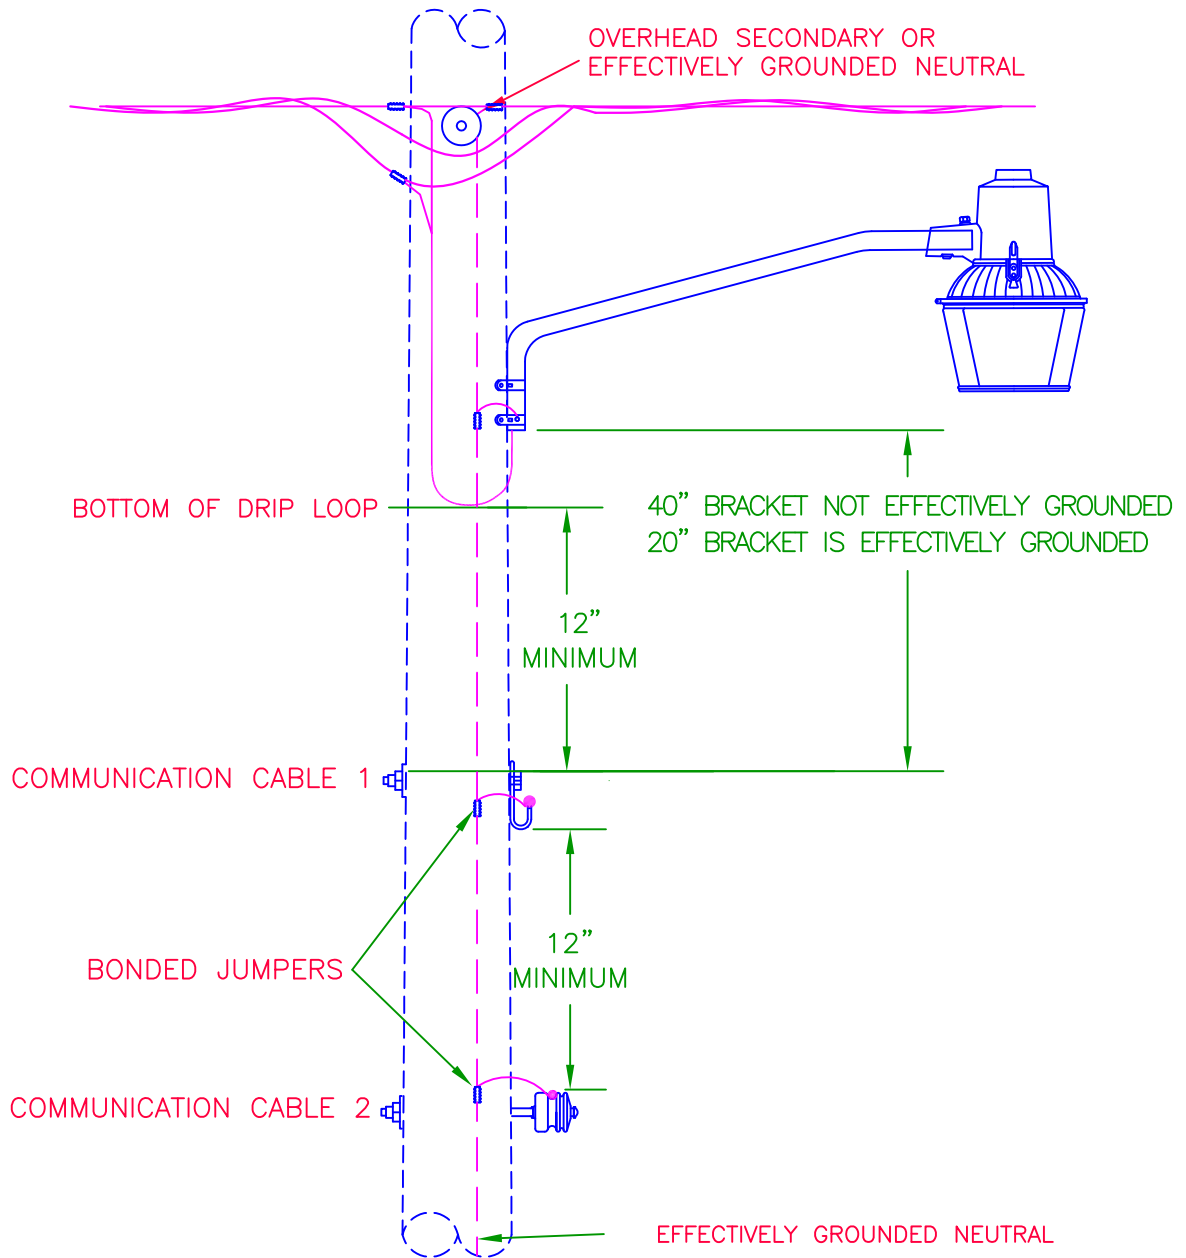

NOTES:

- ALL CABLES SHOULD BE BONDED TO THE EFFECTIVELY GROUND NEUTRAL AS SHOWN ON DRAWING.
- MINIMUM SPACING BETWEEN UTILITY NEUTRAL CONDUCTOR AND COMMUNICATION ATTACHMENT POINTS AT POLE MAY HAVE TO BE INCREASED TO MEET MINIMUM SPAN SEPARATION REQUIREMENTS PER NATIONAL ELECTRIC SAFETY CODE.
- 40" MINIMUM CLEARANCE FROM LOWEST UTILITY BRACKET OR EFFECTIVELY GROUNDED NEUTRAL TO TO UPPER COMMUNICATION CABLE.
- COMMUNICATION CABLES SHOULD MEET ALL RELEVANT CLEARANCES AS REQUIRED BY NATIONAL ELECTRICAL SAFETY CODE.

	ORIGINAL	REVISION	REVISION	REVISION	<b>POLE ATTACHMENT CLEARANCES</b>  <b>CELCO POWER, LLC</b> PINEVILLE , LOUISIANA	EXHIBIT 7
DRWN BY	S.L.T., SR.	R.J.D.	D.J.C.	D.J.C.		SCALE: N.T.S.
CHKD	C.J.F.	K.N.D.	D.J.C.	D.J.C.		SH. ___ OF
APPD	C.J.F.	J.K.L.	J.K.L.			___ SHEETS
DATE	4/22/93	5/23/05	9/7/06	6/20/23		
CADD DRAWING - DO NOT MODIFY MANUALLY						

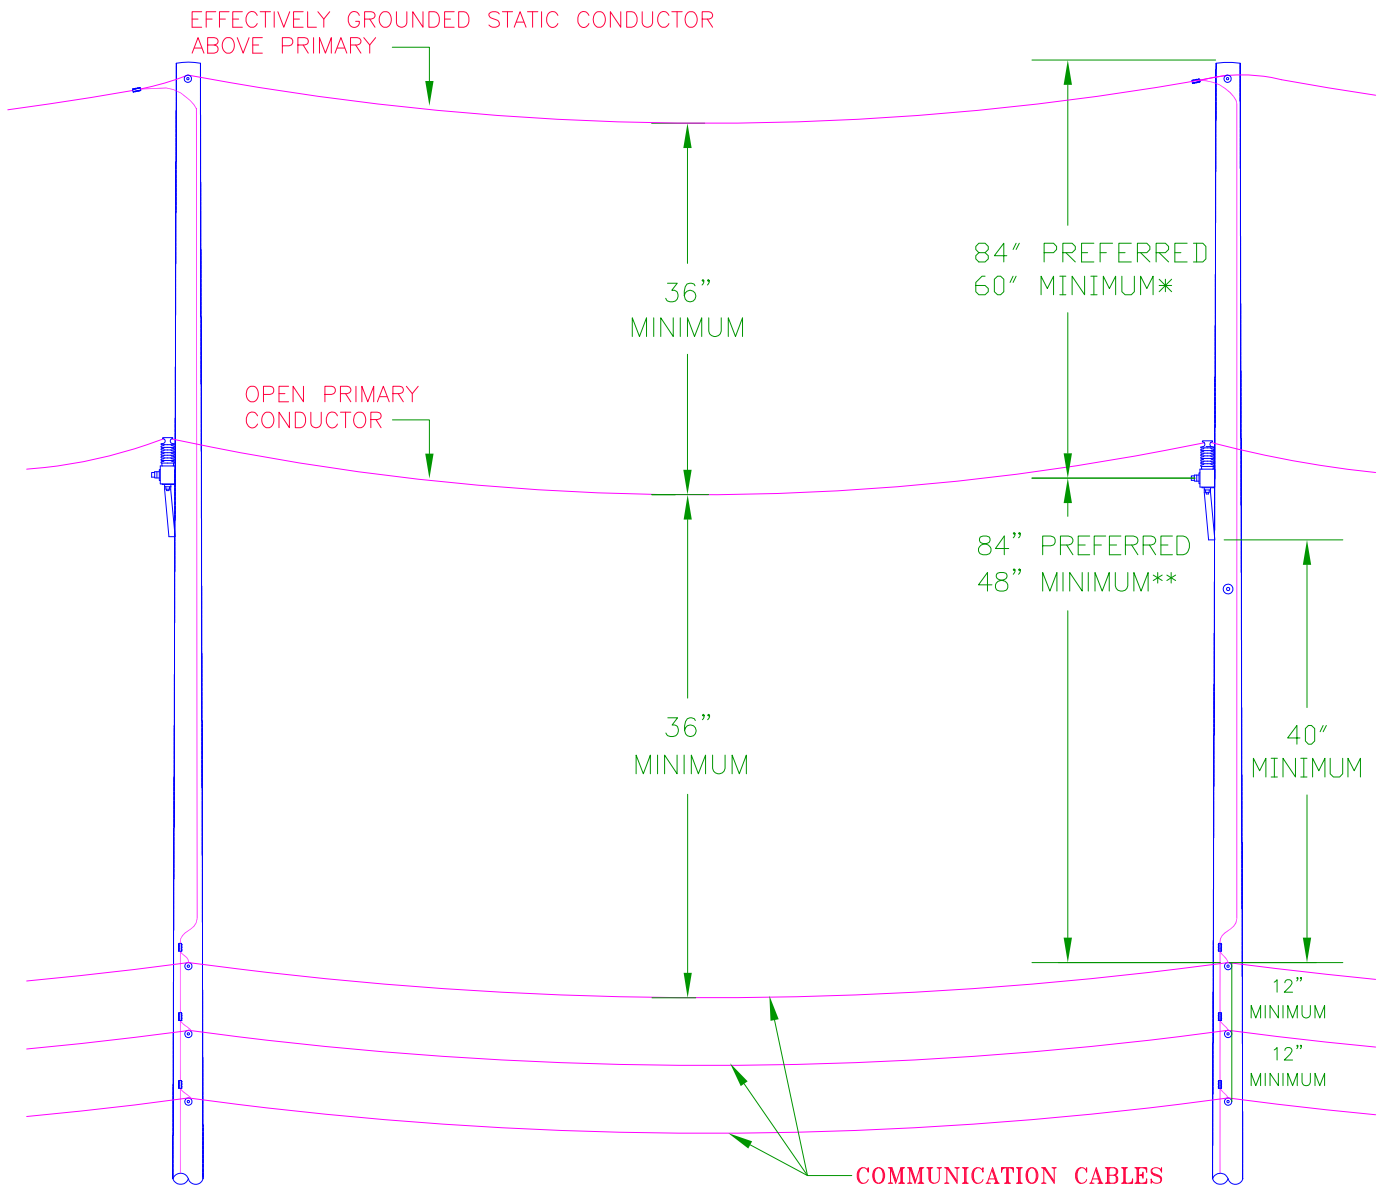

**NOTES:**

- ALL CABLES SHOULD BE BONDED TO THE EFFECTIVELY GROUND NEUTRAL AS SHOWN ON DRAWING.
- MINIMUM SPACING BETWEEN UTILITY NEUTRAL CONDUCTOR AND COMMUNICATION ATTACHMENT POINTS AT POLE MAY HAVE TO BE INCREASED TO MEET MINIMUM SPAN SEPARATION REQUIREMENTS PER NATIONAL ELECTRIC SAFETY CODE.
- 40" MINIMUM CLEARANCE FROM LOWEST UTILITY BRACKET OR EFFECTIVELY GROUNDING NEUTRAL TO UPPER COMMUNICATION CABLE.
- COMMUNICATION CABLES SHOULD MEET ALL RELEVANT CLEARANCES AS REQUIRED BY NATIONAL ELECTRICAL SAFETY CODE.


	ORIGINAL	REVISION	REVISION	REVISION
DRWN BY	S.L.T., SR.	R.J.D.	D.J.C.	M.L.M.
CHKD	C.J.F.	K.N.D.	D.J.C.	D.J.C.
APPD	C.J.F.	J.K.L.	J.K.L.	
APPD				
DATE	4/22/93	5/23/05	9/7/06	6/19/23
CADD DRAWING - DO NOT MODIFY MANUALLY				

POLE ATTACHMENT CLEARANCES  
UTILITY PRIMARY BELOW STATIC CONDUCTOR

**CLECO POWER, LLC**  
PINEVILLE, LOUISIANA

EXHIBIT 8
SCALE: NTS
SH. ___ OF ___ SHEETS



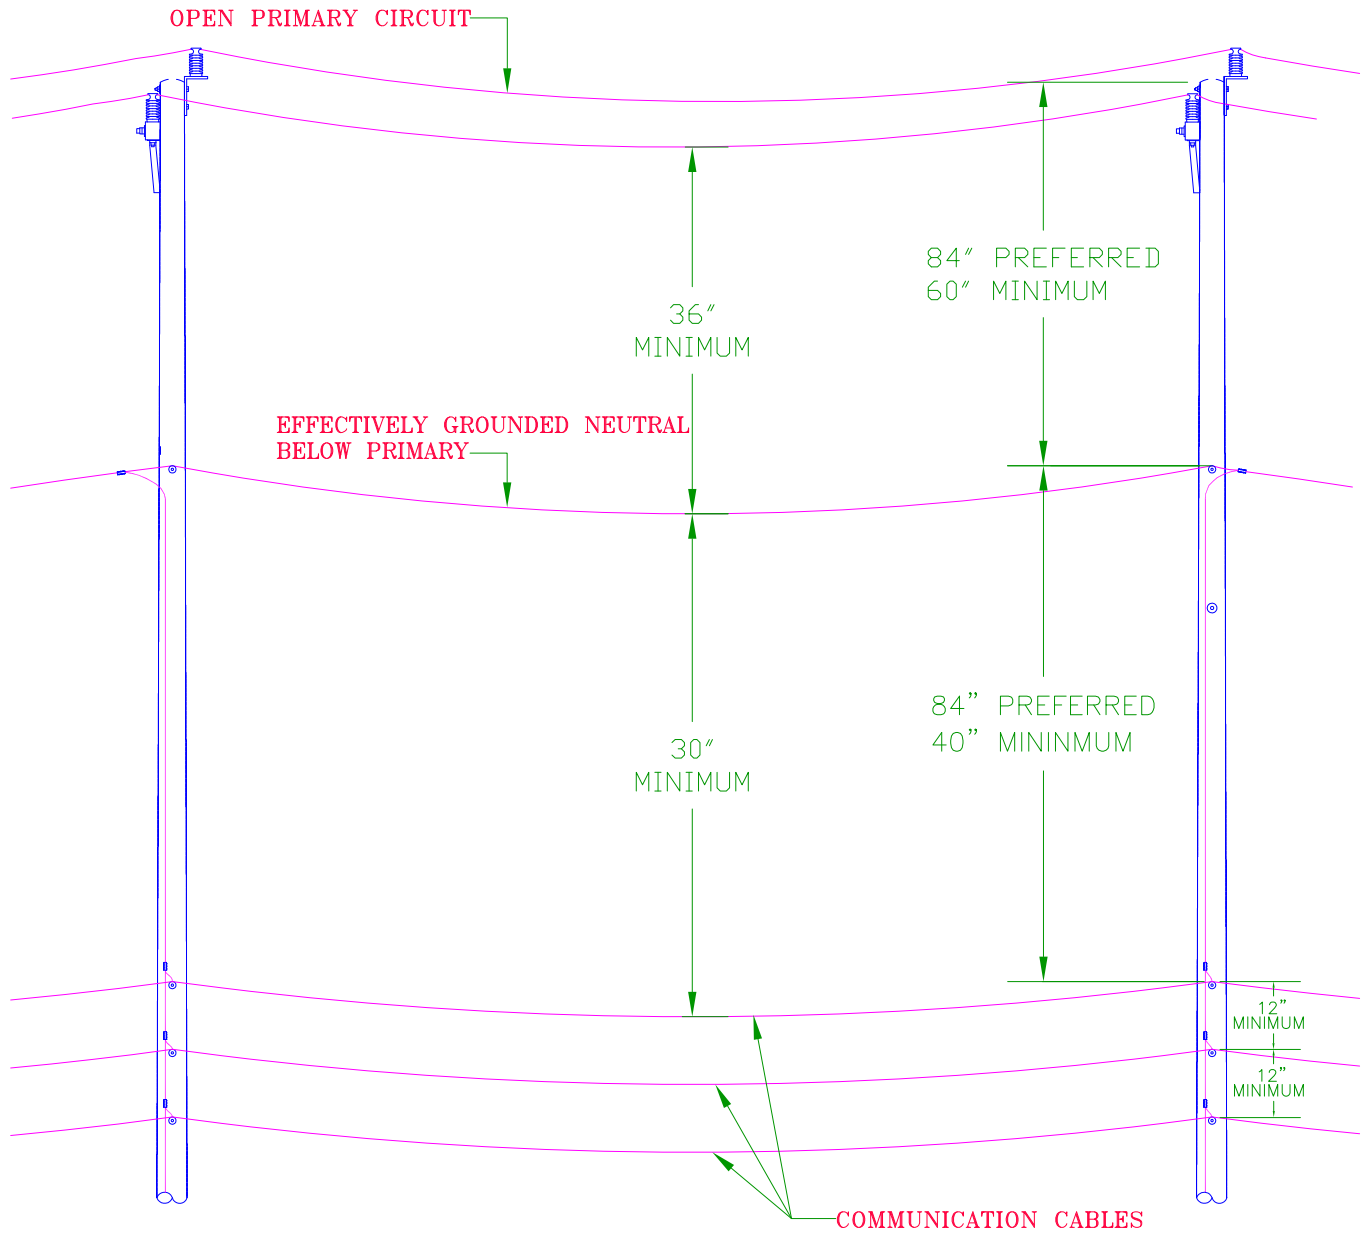

**NOTES:**

- ALL CABLES SHOULD BE BONDED TO THE EFFECTIVELY GROUND NEUTRAL AS SHOWN ON DRAWING.
- MINIMUM SPACING BETWEEN UTILITY NEUTRAL CONDUCTOR AND COMMUNICATION ATTACHMENT POINTS AT POLE MAY HAVE TO BE INCREASED TO MEET MINIMUM SPAN SEPARATION REQUIREMENTS PER NATIONAL ELECTRIC SAFETY CODE.
- 40" MINIMUM CLEARANCE FROM LOWEST UTILITY BRACKET OR EFFECTIVELY GROUNDED NEUTRAL TO TO UPPER COMMUNICATION CABLE.
- COMMUNICATION CABLES SHOULD MEET ALL RELEVANT CLEARANCES AS REQUIRED BY NATIONAL ELECTRICAL SAFETY CODE.

	ORIGINAL	REVISION	REVISION	REVISION
DRWN BY	S.L.T., SR.	R.J.D.	D.J.C.	M.L.M.
CHKD	C.J.F.	K.N.D.	D.J.C.	D.J.C.
APPD	C.J.F.	J.K.L.	J.K.L.	
APPD				
DATE	4/22/93	5/23/05	9/7/06	6/19/23
CADD DRAWING - DO NOT MODIFY MANUALLY				

POLE ATTACHMENT CLEARANCES  
UTILITY NEUTRAL BELOW PRIMARY

**CLECO POWER, LLC**  
PINEVILLE, LOUISIANA


EXHIBIT 9
SCALE: NTS
SH. ___ OF ___ SHEETS

GENERAL NOTES


1. Cleco reserves the top of their distribution poles for Cleco Supply Circuits to provide the safest, most reliable service to its customers. Anyone requesting to install antennas or equipment associated with wireless communication on Cleco distribution poles shall do so only in specified communication space on the pole as outlined by the National Electric Safety Code (NESC).
2. All antenna locations shall be approved by Cleco Distribution Engineering prior to installation.
3. No antennas will be allowed on poles containing Cleco equipment such as: transformer banks, switches (including pipe handle or remote operated), capacitor banks, reclosers, remote metering, regulators, etc.
4. No antennas will be allowed on poles with multiple circuits, crossarms, down-guys, etc. Straight-line tangent poles should be chosen.
5. Clearances shall comply with the National Electrical Safety Code (NESC) and any attached drawings. A "communication worker safety zone" shall be recognized on the poles between "supply space" and "communication space" and no communication attachments or devices will be located closer than 40" to the lowest Cleco Power attachment or drip loop.
6. Any antennas or other telcom wireless attachments not shown or covered in the attached drawings shall be sent to Cleco Distribution Engineering for an evaluation and review which will include a pole loading analysis.
7. Make ready work that includes a new pole will be limited to replacement of an existing wood pole with a maximum length/class pole of 65'/Class-1.
8. Cleco will allow one wireless antenna attachment per distribution pole.
9. Grounding of all telcom equipment shall be done according to current edition of the NESC.
10. Affix a permanent sign to the pole near the communication antenna or communication equipment indicating the Wireless Equipment Owner with emergency contact information and numbers.
11. Affix a permanent sign to the pole near the communication antenna or communication equipment indicating the RF- Radio-Frequency Emissions Data for the wireless equipment installed.

	ORIGINAL	REVISION	REVISION	REVISION	WIRELESS POLE ATTACHMENTS & CLEARANCES AGREEMENT	WIFI AGMNT-1
DRWN BY	MM					SCALE: NTS
CHKD	DJC	DJC			<b>CLECO POWER, LLC</b>	SH. ___ OF
APPD	DJC					___ SHEETS
DATE	3/13/17	2/5/21				
CADD DRAWING - DO NOT MODIFY MANUALLY					PINEVILLE , LOUISIANA	

**FIGURE 1**  
12" of Horizontal Clearance Required from Antenna to Communication/Signal Attachment and Pole Surface.

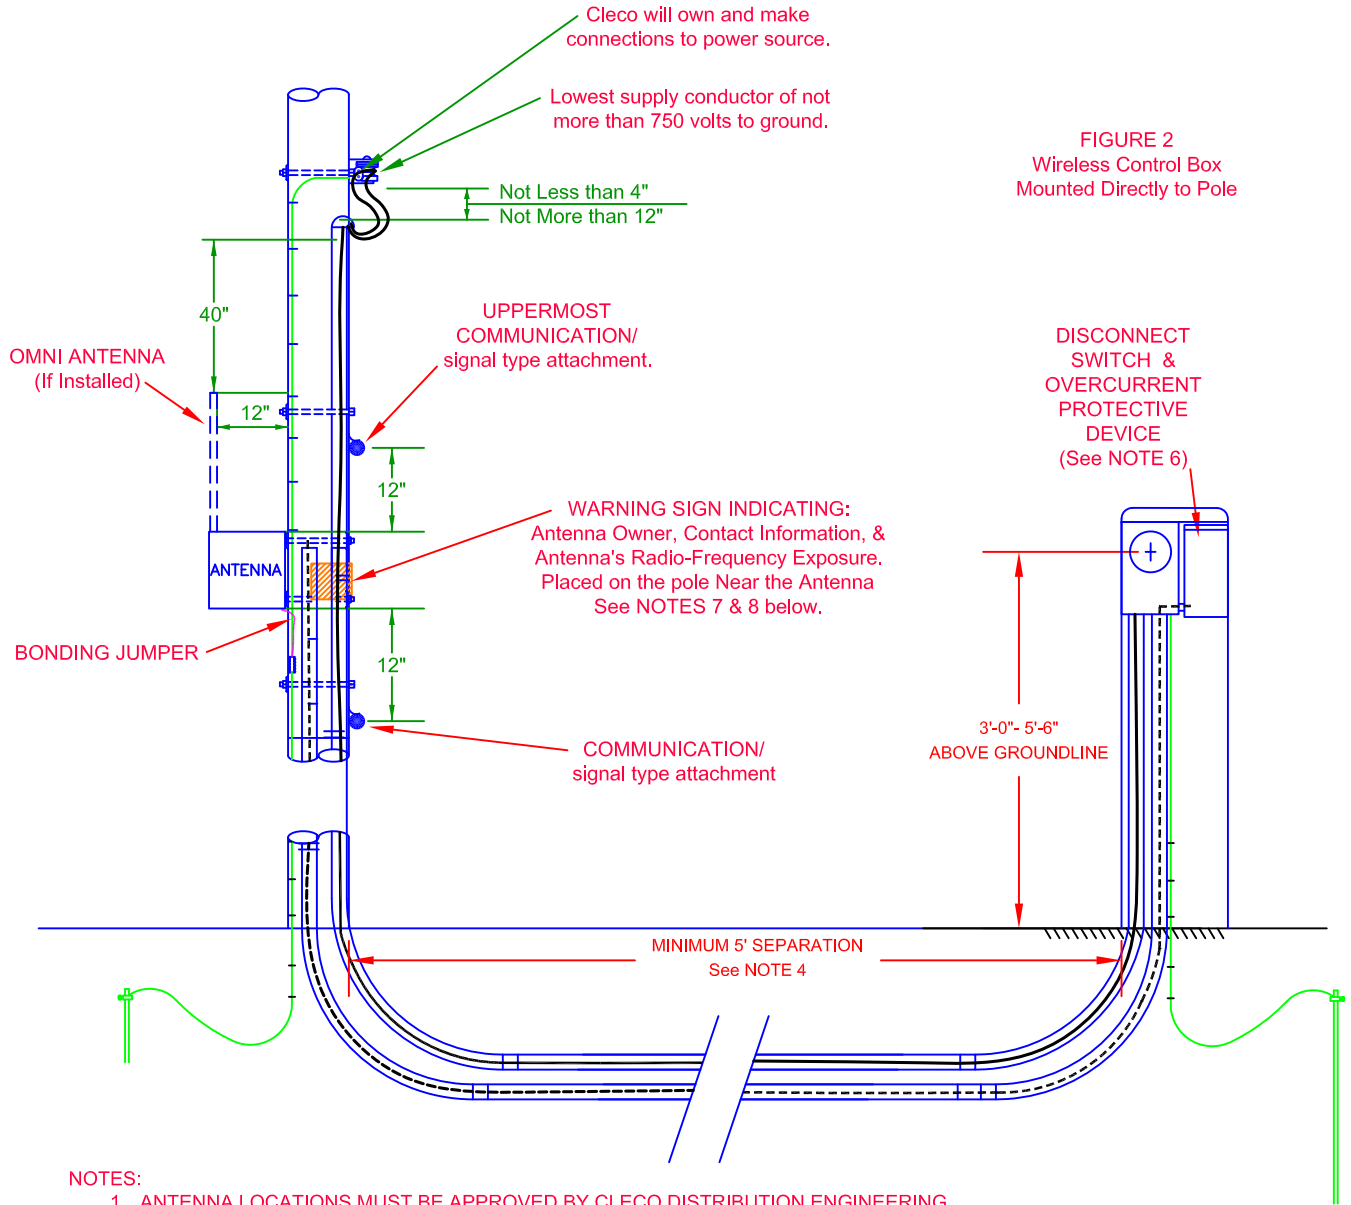

**FIGURE 2**  
Wireless Control Box Mounted Directly to Pole

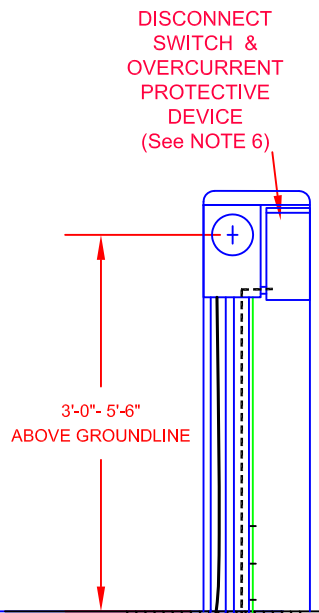

**NOTES:**

1. ANTENNA LOCATIONS MUST BE APPROVED BY CLECO DISTRIBUTION ENGINEERING.
2. DO NOT INSTALL ON POLES CONTAINING CLECO EQUIPMENT SUCH AS: TRANSFORMER BANKS, CAPACITOR BANKS, REGULATOR, RECLOSERS, SWITCHES, ETC,
3. ONE ANTENNA ALLOWED PER POLE.
4. GROUNDING TO COMPLY WITH CURRENT NESC & BONDING JUMPER REQUIRED IF COMMUNICATION LOCATED WITHIN 6' OF CLECO POLES.
5. CLEARANCES TO COMPLY WITH CURRENT NESC.
6. OVERCURRENT PROTECTIVE DEVICE SHALL BE SUPPLIED BY WIRELESS COMPANY AND HAVE THE SAME CLEARANCE REQUIREMENTS TO COMPANY FACILITIES AS COMMUNICATION CABLES.
7. PERMANENT WARNING SIGN ON THE POLE NEAR THE ANTENNA INDICATING RADIO-FREQUENCY EXPOSURE OF THE EQUIPMENT.
8. PERMANENT SIGN INDICATING WIRELESS EQUIPMENT OWNER & CONTACT INFORMATION.

DRWN BY	MLM	REVISION	REVISION	REVISION	<b>WIRELESS POLE ATTACHMENTS &amp; ANTENNA CLEARANCES INSTALLATION</b>  <b>CLECO POWER, LLC</b> PINEVILLE, LOUISIANA	WiFi-1
CHKD	DJC	DJC				SCALE: NTS
APPD	DJC	DJC				SH. ___ OF
APPD						___ SHEETS
DATE	8/31/17	2/5/21				
CADD DRAWING - DO NOT MODIFY MANUALLY						

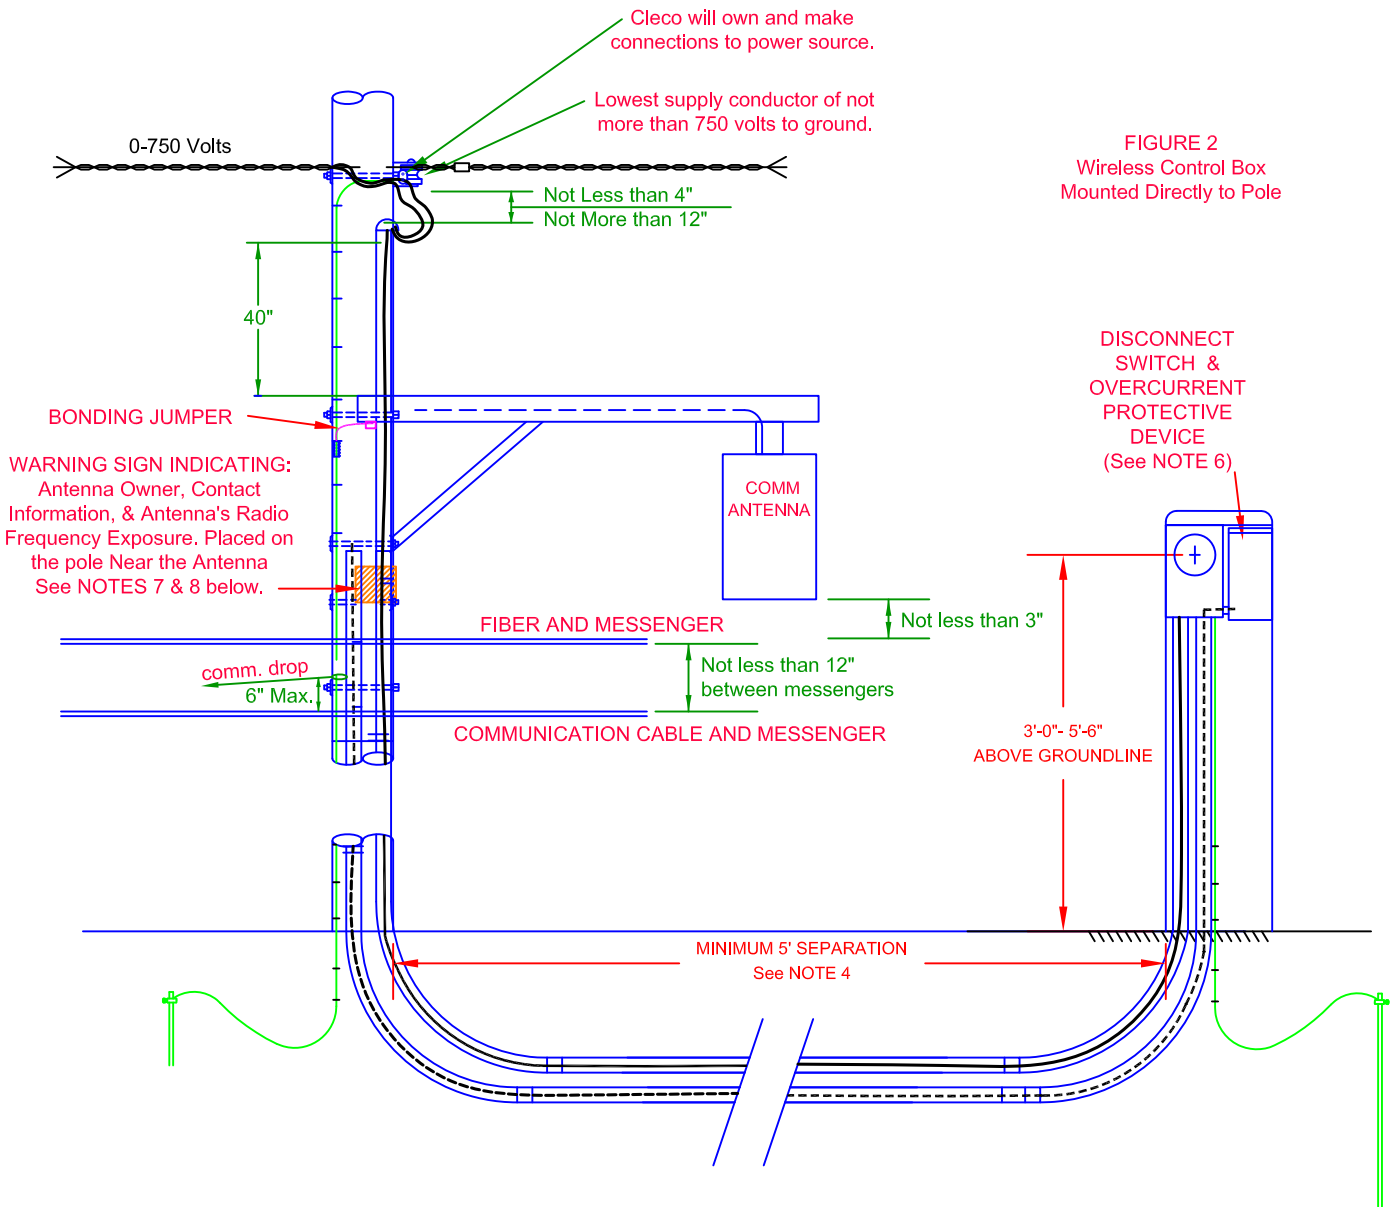


FIGURE 2  
Wireless Control Box  
Mounted Directly to Pole

DISCONNECT  
SWITCH &  
OVERCURRENT  
PROTECTIVE  
DEVICE  
(See NOTE 6)

WARNING SIGN INDICATING:  
Antenna Owner, Contact  
Information, & Antenna's Radio  
Frequency Exposure. Placed on  
the pole Near the Antenna  
See NOTES 7 & 8 below.

NOTES:

1. ANTENNA LOCATIONS MUST BE APPROVED BY CLECO DISTRIBUTION ENGINEERING.
2. DO NOT INSTALL ON POLES CONTAINING CLECO EQUIPMENT SUCH AS: TRANSFORMER BANKS, CAPACITOR BANKS, REGULATOR, RECLOSERS, SWITCHES, ETC,
3. ONE ANTENNA ALLOWED PER POLE.
4. GROUNDING TO COMPLY WITH CURRENT NESC & BONDING JUMPER REQUIRED IF COMMUNICATION LOCATED WITHIN 6' OF CLECO POLES.
5. CLEARANCES TO COMPLY WITH CURRENT NESC.
6. OVERCURRENT PROTECTIVE DEVICE SHALL BE SUPPLIED BY WIRELESS COMPANY AND HAVE THE SAME CLEARANCE REQUIREMENTS TO COMPANY FACILITIES AS COMMUNICATION CABLES.
7. PERMANENT WARNING SIGN ON THE POLE NEAR THE ANTENNA INDICATING RADIO-FREQUENCY EXPOSURE OF THE EQUIPMENT.
8. PERMANENT SIGN INDICATING WIRELESS EQUIPMENT OWNER & CONTACT INFORMATION.

DRWN BY	MM	REVISION	REVISION	REVISION	<b>WIRELESS POLE ATTACHMENTS &amp; ANTENNA CLEARANCE INSTALLATION</b>  <b>CLECO POWER, LLC</b> PINEVILLE, LOUISIANA	WIFI 2
CHKD	DJC	DJC				SCALE: NTS
APPD	DJC	DJC				SH. ___ OF
APPD						___ SHEETS
DATE	3/13/17	2/5/21				
CADD DRAWING - DO NOT MODIFY MANUALLY						