

# Periodic Update to the Brame Fly Ash Pond Inflow Design Flood Control System Plan



**Cleco Power, LLC**

Rodemacher Unit 2  
Project No. 135539

Revision 1  
10/14/2021

# **Periodic Update to the Brame Fly Ash Pond Inflow Design Flood Control System Plan**

prepared for

**Cleco Power, LLC  
Rodemacher Unit 2  
Rapides Parish, Louisiana**

**Project No. 135539**

**Revision 1  
10/14/2021**

prepared by

**Burns & McDonnell Engineering Company, Inc.  
Kansas City, Missouri**

## INDEX AND CERTIFICATION

### Cleco Power, LLC Periodic Update to the Brame Fly Ash Pond Inflow Design Flood Control System Plan

#### Report Index

<u>Chapter Number</u>	<u>Chapter Title</u>	<u>Number of Pages</u>
1.0	Introduction	1
2.0	Plan Objectives	1
3.0	Existing Conditions	1
4.0	Design Basis / Flood Control System	1
5.0	Hydrologic and Hydraulic Capacity	2
6.0	Results	1
7.0	Periodic Assessment and Amendment	1
8.0	Record of Revisions and Updates	1
Appendix A	Site Plan	2
Appendix B	Engineering Calculations	3

#### Certification

I hereby certify, as a Professional Engineer in the state of Louisiana, that the information in this document was assembled under my direct supervisory control. This report is not intended or represented to be suitable for reuse by the Cleco Power, LLC or others without specific verification or adaptation by the Engineer.



---

Jason C. Eichenberger, P.E.  
Louisiana License #42246

Date: October 14, 2021

---

**TABLE OF CONTENTS**

	<u>Page No.</u>
<b>1.0 INTRODUCTION .....</b>	<b>1-1</b>
<b>2.0 PLAN OBJECTIVES .....</b>	<b>2-1</b>
<b>3.0 EXISTING CONDITIONS .....</b>	<b>3-1</b>
<b>4.0 DESIGN BASIS / FLOOD CONTROL SYSTEM .....</b>	<b>4-1</b>
4.1 Hazard Potential Classification.....	4-1
4.2 Inflow Design Flood System Criteria .....	4-1
4.2.1 Capacity Criteria .....	4-1
4.2.2 Freeboard Criteria .....	4-1
4.2.3 Flood Routing Design Criteria.....	4-1
4.3 Project Mapping.....	4-1
4.3.1 Mapping Sources .....	4-1
4.3.2 Vertical Datum.....	4-1
4.3.3 Horizontal Coordinate System.....	4-1
<b>5.0 HYDROLOGIC AND HYDRAULIC CAPACITY .....</b>	<b>5-1</b>
5.1 Pond Inflows .....	5-1
5.1.1 Runoff .....	5-1
5.1.2 Process Flows.....	5-1
5.2 Pond Outflows .....	5-2
<b>6.0 RESULTS.....</b>	<b>6-1</b>
<b>7.0 PERIODIC ASSESSMENT AND AMENDMENT.....</b>	<b>7-1</b>
<b>8.0 RECORD OF REVISIONS AND UPDATES.....</b>	<b>8-1</b>
<b>APPENDIX A – SITE PLAN</b>	
<b>APPENDIX B – ENGINEERING CALCULATIONS</b>	

## LIST OF TABLES

	<b><u>Page No.</u></b>
Table 5-1: Watershed Runoff Calculated Data for Brame Fly Ash Pond.....	5-1
Table 6-1: Modeled Pond Design and Proposed Conditions .....	6-1

**LIST OF ABBREVIATIONS**

<b><u>Abbreviation</u></b>	<b><u>Term/Phrase/Name</u></b>
ac	acre
BMcD	Burns & McDonnell
Brame	Brame Energy Center
CCR	Coal Combustion Residual
CFR	Code of Federal Regulations
cfs	cubic feet per second
Cleco	Cleco Power, LLC
CY	cubic yard
ELG	Effluent Limitations Guidelines
EPA	Environmental Protection Agency
ft	feet
GPM	Gallons per Minute
hr	hour
in	inch
LDOTD	Louisiana Department of Transportation and Development
LPDES	Louisiana Pollutant Discharge Elimination System
LSU	Louisiana State University
MGD	Million Gallons per Day
min	minute
NAD 83	North American Datum of 1983
NAVD 88	North American Vertical Datum of 1988

<b><u>Abbreviation</u></b>	<b><u>Term/Phrase/Name</u></b>
NGVD 29	National Geodetic Vertical Datum of 1929
NRCS	Natural Resources Conservation Service
PFDS	Precipitation Frequency Data Server
RCRA	Resource Conservations and Recovery Act
SCS	Soil Conservation Service
U.S.C.	United States Code
USDA	US Department of Agriculture

## 1.0 INTRODUCTION

On April 17, 2015, the Environmental Protection Agency (EPA) issued the final version of the federal Coal Combustion Residual (CCR) Rule to regulate the disposal of CCR materials generated at coal-fired units. The rule will be administered as part of the Resource Conservation and Recovery Act [RCRA, 42 United States Code (U.S.C.) §6901 et seq.], using the Subtitle D approach.

The existing CCR impoundments at Cleco Power, LLC's (Cleco's) Brame Energy Center (Brame) are subject to the CCR Rule and as such must meet the hydrologic and hydraulic capacity requirements outlined in 40 Code of Federal Regulations (CFR) §257.82. This report serves as the periodic update to the inflow design flood control system plan for the Fly Ash Pond at Brame.

This inflow design flood control system plan is in addition to, not in place of, any other applicable site permits, environmental standards, or work safety practices.



## 2.0 PLAN OBJECTIVES

Per 40 CFR §257.82, the inflow design flood control system plan must contain documentation (including supporting engineering calculations) that the inflow design flood control system has been designed and constructed to:

- Adequately manage flow into the CCR unit during and following the peak discharge of the inflow design flood,
- Adequately manage flow from the CCR unit to collect and control the peak discharge resulting from the inflow design flood, and
- Handle discharge from the CCR surface impoundment in accordance with the surface water requirements described in 40 CFR §257.3-3.

Per 40 CFR §257.82(c)(5), Cleco must obtain certification from a qualified professional engineer that the inflow design flood control system plan, and subsequent updates to the plan, meet the requirements of 40 CFR §257.82. This sealed document serves as that certification.

### 3.0 EXISTING CONDITIONS

Brame is located northwest of Alexandria in Rapides Parish, Louisiana. The Fly Ash Pond is a 36.3-acre diked pond with approximately 750,000 CY of ash capacity. A site plan is included in Appendix A. The impoundment is surrounded by a 20-foot-wide perimeter dike with a crest elevation of approximately 105. The dike on the northwest side is shared with the Bottom Ash Pond.

The pond receives ESP fly ash from the dry fly ash silo that is loaded onto trucks, hauled, and deposited in the pond. The low operating level is 86 feet and high operating level is 92 feet (NAVD 88). Flow from the pond is discharged by manually pumping to the Bottom Ash Pond via a 6-inch HDPE pipe. The Bottom Ash Pond discharges to a channel on the northwest embankment via a 24-inch corrugated metal pipe. From the channel, excess flow can be discharged into Lake Rodemacher through permitted LPDES Outfall 401.

## **4.0 DESIGN BASIS / FLOOD CONTROL SYSTEM**

### **4.1 Hazard Potential Classification**

Per 40 CFR §257.73, Cleco has determined the Brame Fly Ash Pond to be a significant hazard potential CCR surface impoundment.

### **4.2 Inflow Design Flood System Criteria**

#### **4.2.1 Capacity Criteria**

The CCR Rule requires CCR surface impoundments to have adequate hydrologic and hydraulic capacity to manage flows for the inflow design flood. For this analysis, the criteria was interpreted as being the top of the surface impoundment dike should not be overtopped during the inflow design flood event.

#### **4.2.2 Freeboard Criteria**

The CCR documentation further discusses that operating freeboard must be adequate to meet performance standards, but a specific freeboard is not defined.

#### **4.2.3 Flood Routing Design Criteria**

The inflow design flood for this analysis is a 1,000-year flood event per 40 CFR §257.82(a)(3)(ii).

### **4.3 Project Mapping**

Project mapping for this analysis consisted of an inventory of stormwater assets that contribute to the surface impoundment. Three primary sources of information were utilized: construction record drawings, plant operational information, and survey data.

#### **4.3.1 Mapping Sources**

Survey data utilized included LIDAR topography from the Louisiana State University (LSU) Atlas Lidar Downloader, retrieved in January of 2016. Construction record drawings of the surface impoundment and owner-provided information were also utilized in the analysis.

#### **4.3.2 Vertical Datum**

Mapping sources referenced were in the North American Vertical Datum of 1988 (NAVD 88).

#### **4.3.3 Horizontal Coordinate System**

Data from the LSU Atlas Lidar which was utilized as the basis for mapping and modeling efforts is in the Louisiana State Plane North, North American Datum 1983 (NAD 83) coordinate system.

## 5.0 HYDROLOGIC AND HYDRAULIC CAPACITY

HEC-HMS 4.0 was used to model reservoir characteristics under the design storm event. Inputs to the HEC-HMS model were assumed to be as follows.

### 5.1 Pond Inflows

#### 5.1.1 Runoff

##### 5.1.1.1 Recurrence Interval and Rainfall Duration

The inflow flood design event for this study, as dictated by the hazard potential classification, was a 1,000-year flood event. Because a storm duration is not specified under 40 CFR §257.82 or other pertinent inflow flood design sections within the CCR Rule, a 24-hour storm duration was utilized.

##### 5.1.1.2 Rainfall Distribution and Depth

The Soil Conservation Service (SCS) Type III rainfall distribution was used for computations associated with this evaluation. Precipitation data was acquired from the NOAA Precipitation Frequency Data Server (PFDS). Precipitation depth for the inflow design flood event is 22.6 inches.

##### 5.1.1.3 Subbasin Characteristics

Calculations were determined based on the watershed parameters shown in Table 5-1. Refer to Appendix A for more detailed calculations.

**Table 5-1: Watershed Runoff Calculated Data for Brame Fly Ash Pond**

Component	Value	Unit
Watershed Area	38.8	ac
SCS Storm Depth: 1,000-yr, 24-hr	22.6	in
Weighted Curve Number	88	-
Initial Abstraction	0.273	in
Time of Concentration	22.48	min
Basin Lag Time	13.49	min

#### 5.1.2 Process Flows

When conducting the hydraulic analysis, it was assumed the pond level is at the high operating level (92.0 feet) prior to the storm event. All runoff into the pond is considered additional flow above the initial elevation. No process flows are currently routed to the Fly Ash Pond, so it was assumed precipitation would be the only pond inflow over the duration of the storm event control period.

## 5.2 Pond Outflows

Stage discharge information was not included in this model. To be conservative, it was assumed the Fly Ash Pond manual pump would not be operated for the duration of the storm event control period.

## 6.0 RESULTS

The pond was modeled for a 1,000-year, 24-hour storm event with the initial elevation set at the high operating level, no discharge, and the pond being 50% full of fly ash up to the top of the dike.

Under the design conditions, the pond was able to contain runoff from the 1,000-year, 24-hour storm without overtopping. The results of the modeled storm event are as follows:

**Table 6-1: Modeled Pond Design and Proposed Conditions**

Component	Property	Value	Unit
<b>Subbasin Watershed</b>	Peak Discharge	539.5	cfs
	Runoff Volume	21.04	in
<b>Reservoir Fly Ash Pond – 50% full of ash</b>	Initial EL	92.0	ft
	Peak Inflow	540.7	cfs
	Peak Discharge	0.0	cfs
	Peak Elevation	96.3	ft
	Peak Storage	68.9	ac-ft

After a significant storm event, excess water collected in the Fly Ash Pond can be discharged via pumping to the Bottom Ash Pond similar to current operations. From there, excess water can be pumped to the overflow channel for discharge via permitted LPDES Outfall 401.

## **7.0 PERIODIC ASSESSMENT AND AMENDMENT**

Cleco placed the initial plan in the CCR Operating Record by October 17, 2016. Periodic inflow design flood control system plans are required every five years. This report serves as the first periodic update to the inflow design flood control system plan. Cleco may publish revised plans at shorter intervals, noting, however, the deadline for publishing the next revision will be maintained as five years after publishing the previous revision. Cleco may amend the plan at any time and is required to do so whenever there is a change in conditions which would affect the current plan. All amendments and revisions must be placed on the CCR public website. A record of revisions made to this document is included in Section 8.0.







**APPENDIX A – SITE PLAN**

**NOTES:**

- EXISTING CONTOURS PER LOUISIANA STATE UNIVERSITY ATLAS LIDAR DOWNLOADER, RETRIEVED JANUARY 2016
- ASH POND OPERATING CHARACTERISTICS ARE AS FOLLOWS:


	WATERSHED AREA (AC)	HIGH OPERATING LEVEL (FT)
FLY ASH POND	38.8	92

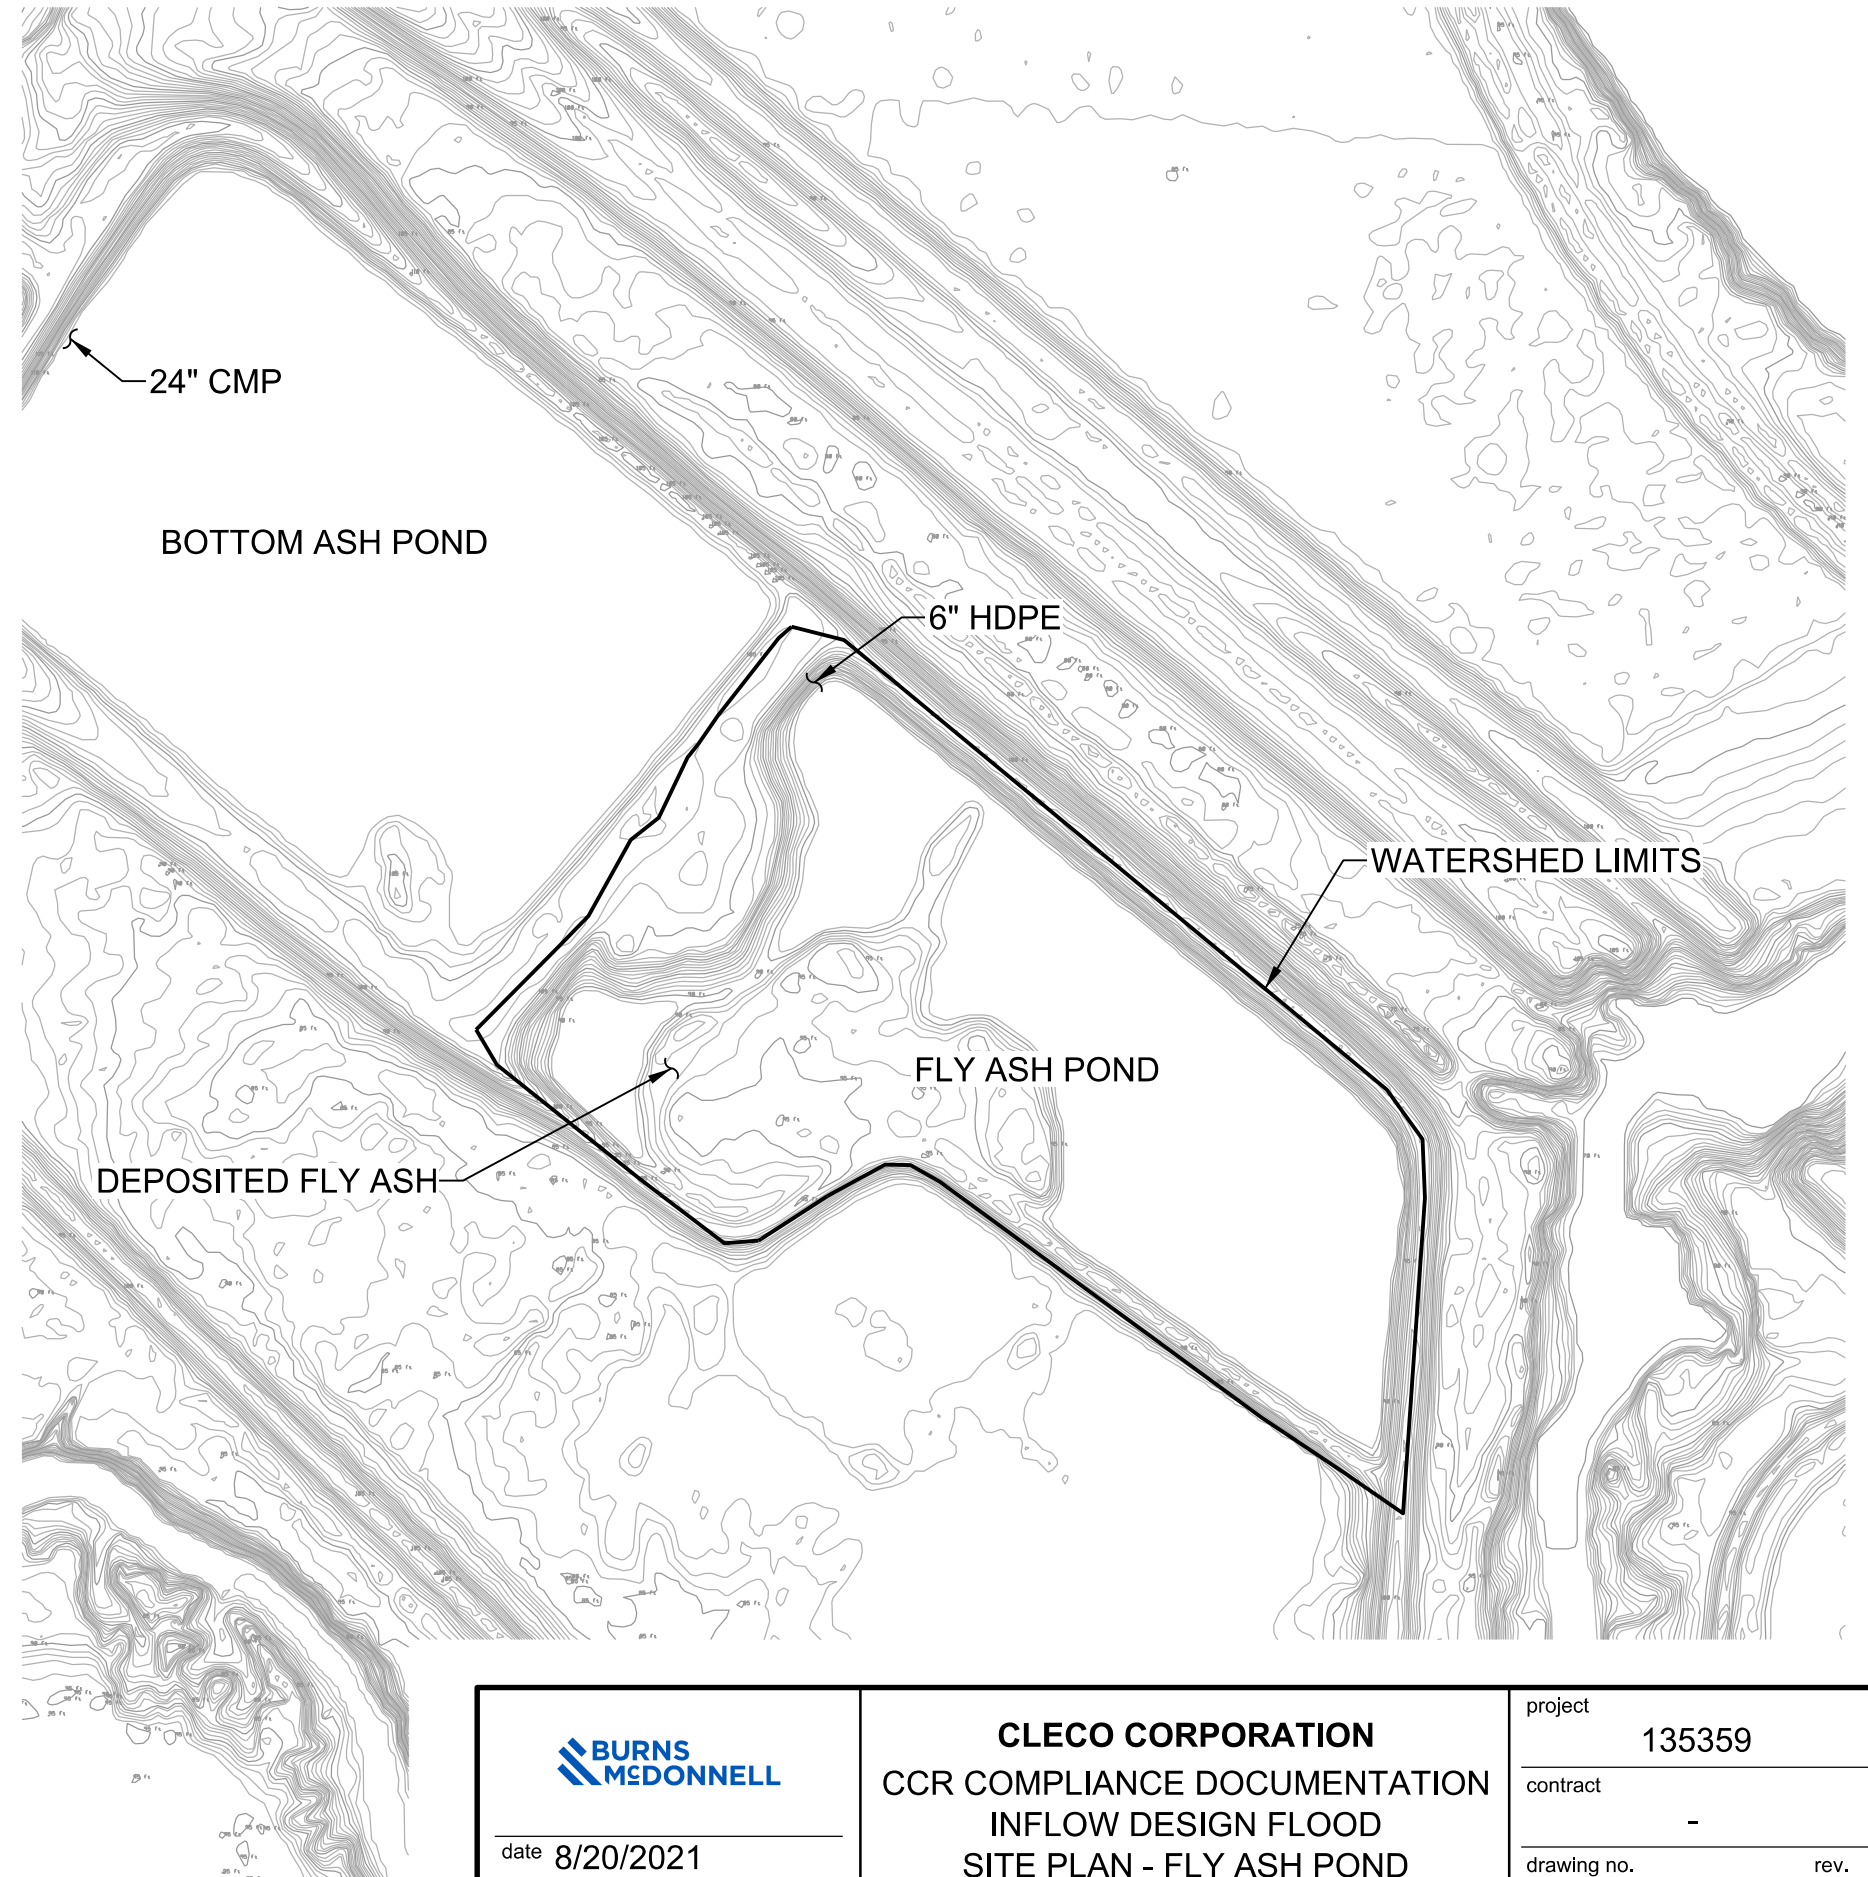

date 8/20/2021  
 designed A. MYERS


**CLECO CORPORATION**  
 CCR COMPLIANCE DOCUMENTATION  
 INFLOW DESIGN FLOOD  
 SITE PLAN - FLY ASH POND

project 135359  
 contract -  
 drawing no. SK - CIVIL - 001 rev. 0

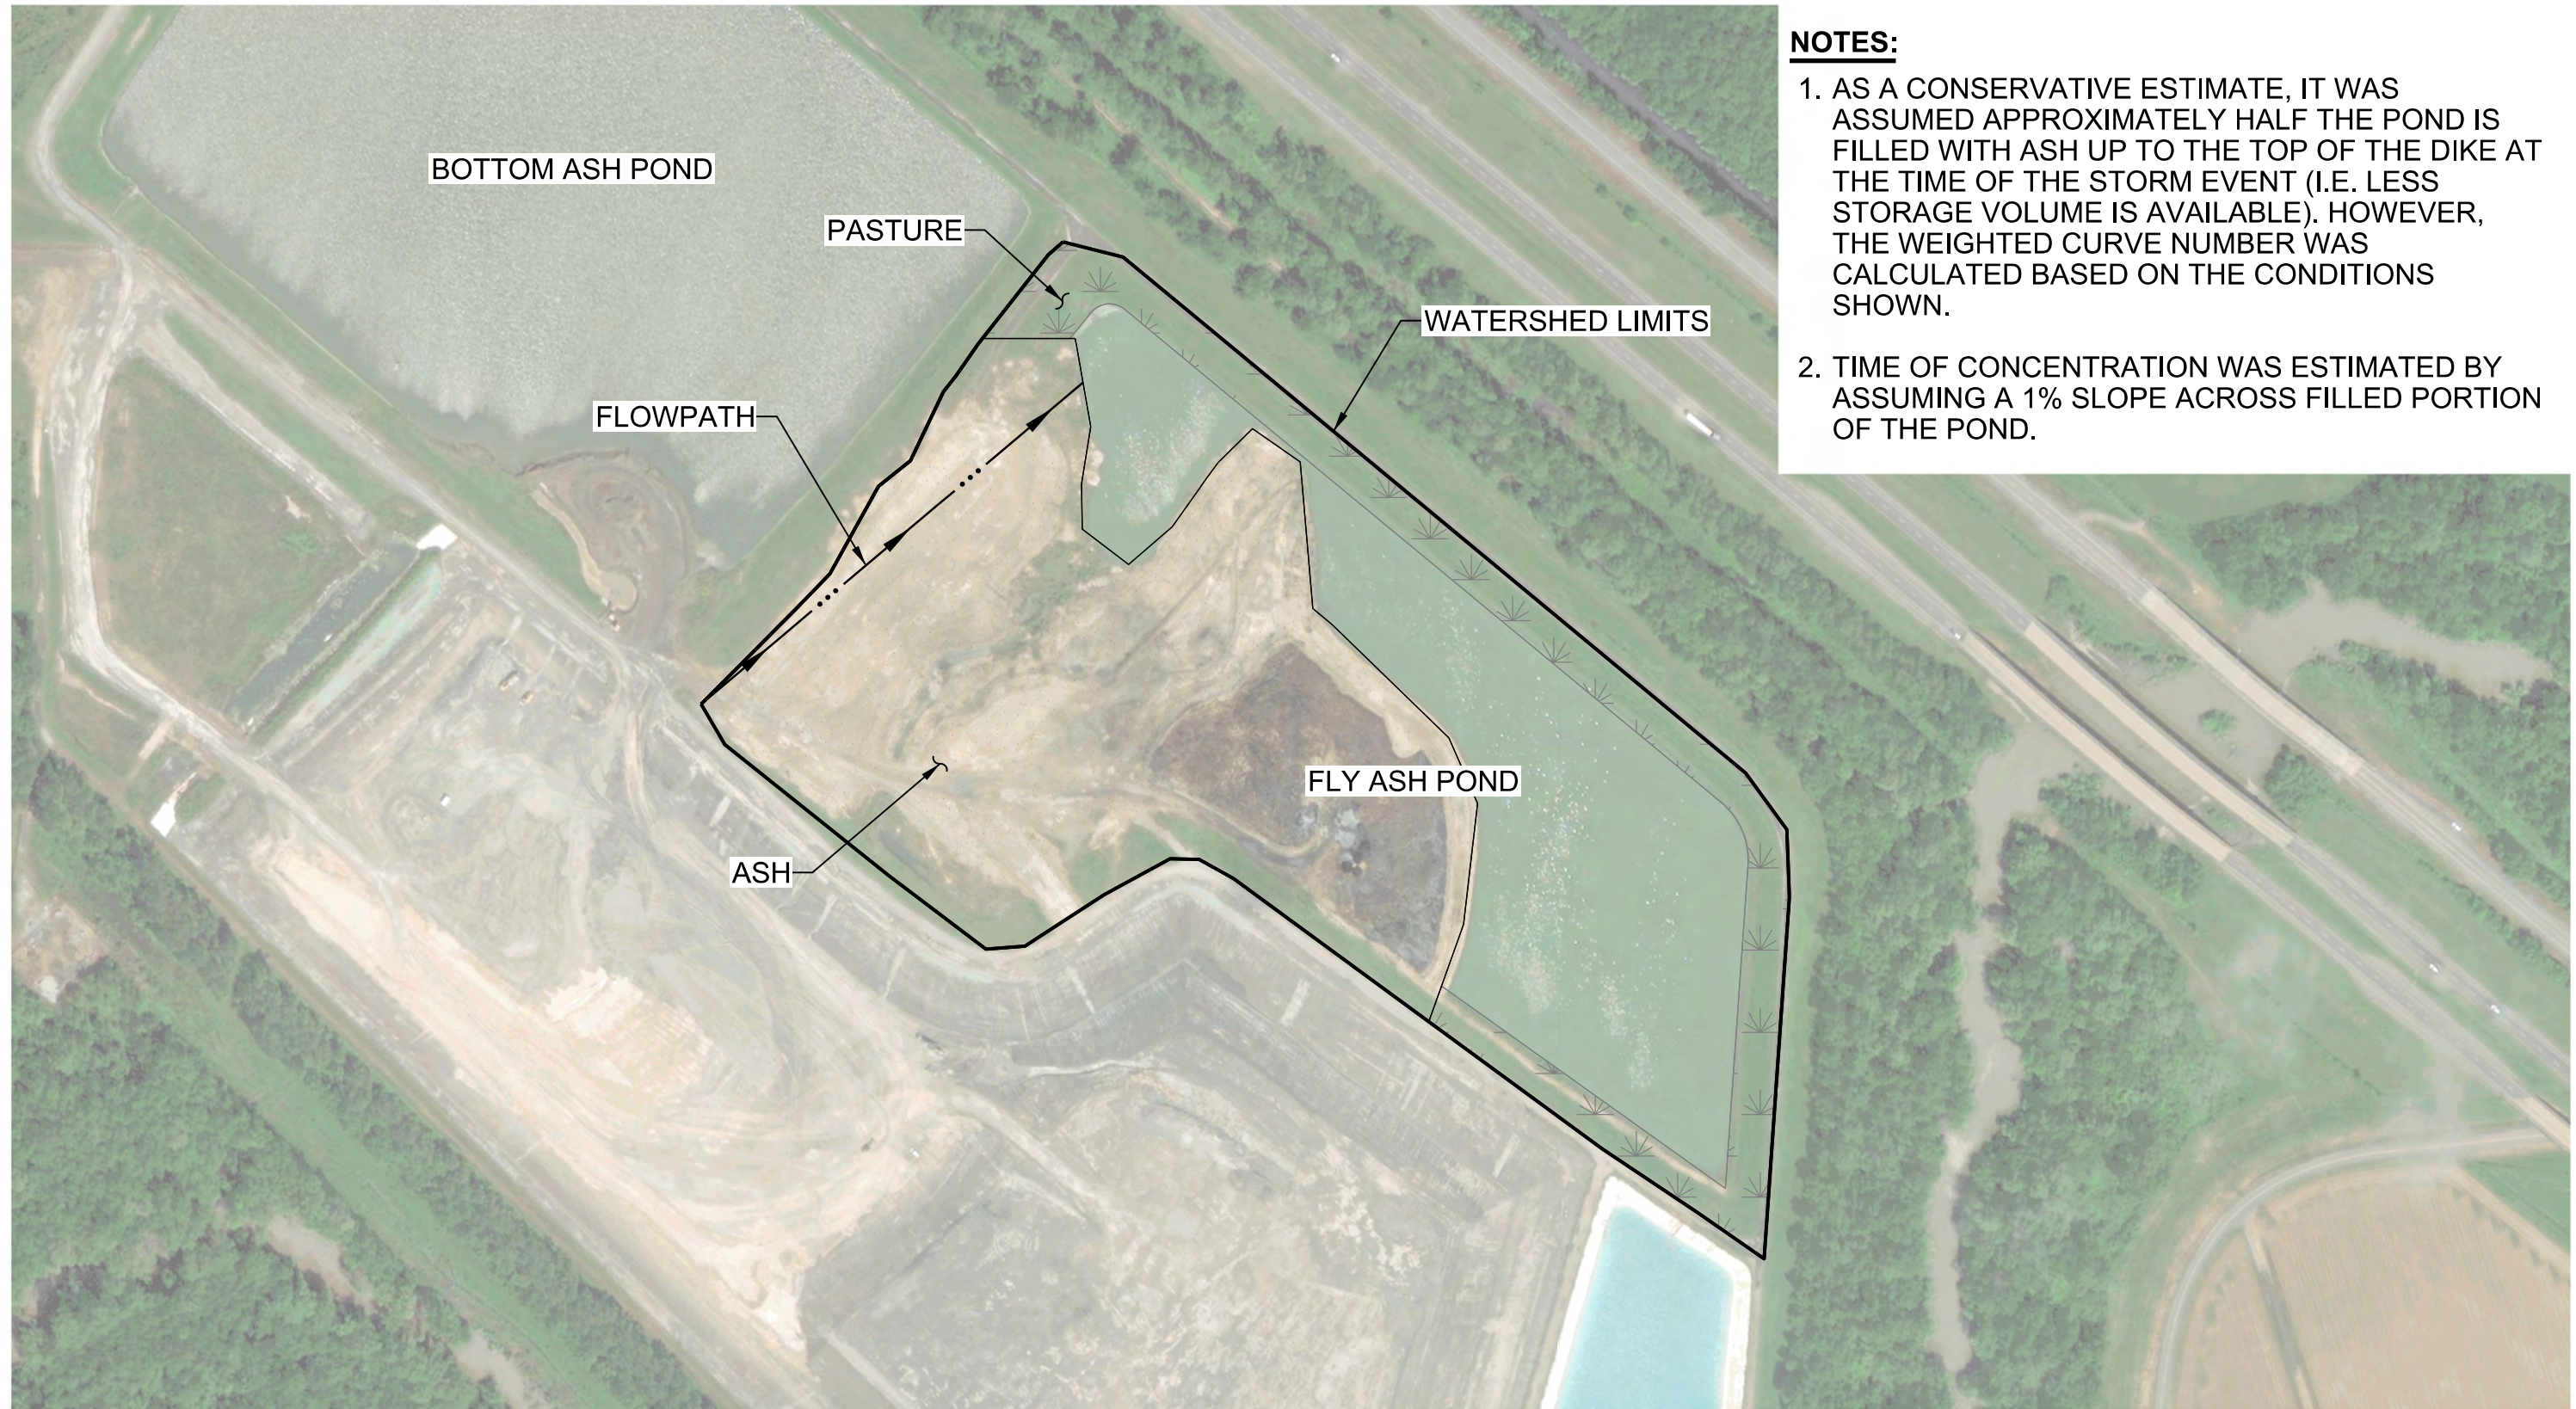

**NOTES:**

1. AS A CONSERVATIVE ESTIMATE, IT WAS ASSUMED APPROXIMATELY HALF THE POND IS FILLED WITH ASH UP TO THE TOP OF THE DIKE AT THE TIME OF THE STORM EVENT (I.E. LESS STORAGE VOLUME IS AVAILABLE). HOWEVER, THE WEIGHTED CURVE NUMBER WAS CALCULATED BASED ON THE CONDITIONS SHOWN.
2. TIME OF CONCENTRATION WAS ESTIMATED BY ASSUMING A 1% SLOPE ACROSS FILLED PORTION OF THE POND.

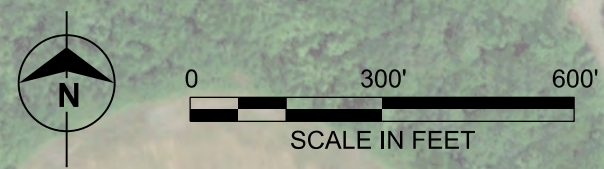

 date 8/20/2021 designed A. MYERS	<b>CLECO CORPORATION</b> CCR COMPLIANCE DOCUMENTATION INFLOW DESIGN FLOOD SITE PLAN - FLY ASH POND	project 135359
	drawing no. <b>SK - CIVIL - 002</b>	contract -

## **APPENDIX B – ENGINEERING CALCULATIONS**



- 10 Weighted Curve Number  
 $CN_W = (CN_i * A_i) / A_T$
- 11 Weighted Rational Runoff Coefficient  
 $C_W = (C_i * A_i) / A_T$

**VARIABLES:**

- 1 Q peak runoff rate, cfs  
 2 C rational runoff coefficient, unitless  
 3 I rainfall intensity, in/hr  
 4 A<sub>d</sub> total drainage area, ac or mi<sup>2</sup>  
 5 t<sub>sheet</sub> sheet flow travel time, min  
 6 n Manning's roughness coefficient, unitless  
 7 L hydraulic length of the watershed, ft  
 8 P<sub>2</sub> 2yr 24hr rainfall, in  
 9 S<sub>decimal</sub> slope, ft/ft  
 10 t<sub>shallow</sub> shallow concentrated flow travel time, min  
 11 V<sub>shallow</sub> shallow velocity, ft/s  
 12 t<sub>channel</sub> channel flow travel time, min  
 13 V<sub>channel</sub> channel velocity, ft/s  
 14 t<sub>c</sub> time of concentration, min  
 15 t<sub>lag</sub> lag time, hrs  
 16 S soil water storage capacity, in  
 17 CN curve number, unitless  
 18 I<sub>a</sub> initial abstraction, in  
 19 CN<sub>W</sub> weighted curve number, unitless  
 20 A<sub>T</sub> total area, ac  
 21 C<sub>W</sub> weighted rational runoff coefficient, unitless  
 22 CN<sub>WT</sub> total weighted curve number, unitless  
 23 C<sub>WT</sub> weighted rational runoff coefficient, unitless

**CALCULATIONS:**

- 1 Establish drainage area

Fly Ash Pond	
A <sub>d</sub> (ac)	38.8
A <sub>d</sub> (mi <sup>2</sup> )	0.061

Measured in Microstation, see SK-CIVIL-001 in Appendix A. Area delineated using contours generated from the LSU Atlas Lidar.  
 Conversion from ac to mi<sup>2</sup>

- 2 Establish rainfall data (assume SCS Type III distribution)

SCS Storm	Depth (in)
1000yr, 24hr	22.6

Reference 3

- 3 Establish CN, percent impervious cover, and initial abstraction. Assume antecedent moisture condition (AMC) II - average conditions.

Land Description	Fly Ash Pond		
	CN <sub>i</sub> *	A <sub>i</sub> ** (ac)	CN <sub>W</sub>
Open space, fair condition	69	5.6	10
Open space, poor condition (ash)	86	21.1	47
Pond	100	12.0	31
A <sub>T</sub> (ac)		38.8	
CN <sub>WT</sub>			88
S (in)			1.36
I <sub>a</sub> (in)			0.273

Equation 10

Equation 10

Equation 10

Sum

Sum

Equation 8

Equation 9

\*Reference 1, Table 20.4, p. 20-17 and Assumptions 4 & 5

\*\*Measured in Microstation, see SK-CIVIL-002 in Appendix A. Adjusted ash area based on Assumption 4.

- 4 Establish Time of Concentration and Basin Lag time for SCS Unit Hydrograph Transform

Subbasin	Fly Ash Pond
<b>Sheet Flow</b>	
n	0.06
L* (ft)	300
P <sub>2</sub> (in)	5.13
S* <sub>decimal</sub> (ft/ft)	0.01
t <sub>sheet</sub> (hrs)	0.20
t <sub>sheet</sub> (min)	11.81
<b>Shallow Flow</b>	
S* <sub>decimal</sub> (ft/ft)	0.01
V <sub>shallow</sub> (ft/s)	1.00
L* (ft)	640
t <sub>shallow</sub> (s)	640.00
t <sub>shallow</sub> (min)	10.67
<b>Time of Concentration</b>	
t <sub>c</sub> (min)	22.48
<b>Lag Time</b>	
t <sub>lag</sub> (min)	13.49

Reference 1, p. 20-3, Table 20.1 - cultivated soils (cover <20%)

Measured in Microstation, see SK-CIVIL-002 in Appendix A

Reference 3, 2yr 24hr rainfall

Assumed 1% slope across ash

Equation 2

Conversion from hrs to min

Assumed 1% slope across ash

Reference 4, Figure 15-4

Measured in Microstation, see SK-CIVIL-002 in Appendix A

Equation 3

Conversion from s to min

Equation 6

Equation 7

\*Measured in Microstation

5 Run HEC-HMS with input parameters: all discharge into ponds (rainfall) is additional flow above the initial elevation (EL 92).  
 Elevation-area data for the pond is as noted below.

EL	area* (ac)
92	15.568
93	15.754
94	15.941
95	16.128
96	16.317
97	16.506
98	16.696
99	16.887
100	17.078
101	17.270
102	17.463
103	17.656
104	17.850
105	18.045

\*Measured in Microstation and adjusted based on pond being 50% full of ash

**RESULTS:**

Component	Subbasin		Reservoir				
	Peak Discharge (cfs)	Runoff Volume (in)	Initial EL*	Peak Inflow (cfs)	Peak Discharge (cfs)	Peak Elevation (ft)	Peak Storage** (ac-ft)
Fly Ash Pond	539.5	21.04	92.0	540.7	0.0	96.3	68.9

\*High operating level per CCR Annual Inspection Report

\*\*Peak storage reflects storage above initial EL

**CONCLUSION:**

Under the modeled conditions, the Fly Ash Pond can accept inflows from the design flood event without overtopping.  
 Excess water may be discharged to the Bottom Ash Pond by activating the existing, manually-operated pump.



CREATE AMAZING.

Burns & McDonnell World Headquarters  
9400 Ward Parkway  
Kansas City, MO 64114  
O 816-333-9400  
F 816-333-3690  
[www.burnsmcd.com](http://www.burnsmcd.com)